



Renewable Energy Approval Documents

Cochrane Solar Project
Executive Summary

January 25, 2013

January 25, 2013

**Northland Power Inc.
Cochrane Solar Project**

Executive Summary

Table of Contents

1. Introduction	3
1.1 Project Location	4
1.2 Project Proponent	5
1.3 Project Benefits	5
1.4 Project Description	6
2. REA Process.....	6
2.1 Brief Summary of the Cochrane Solar Project REA Reports	7
3. Next Steps	8
Figure 1: Report Name and Purpose.....	9
Figure 2: Appendices of Project Report Summaries	10

Disclaimer

This report has been prepared by or on behalf of Northland Power Inc. for submission to the Ontario Ministry of the Environment as part of the Renewable Energy Approval process. The content of this report is not intended for the use of, nor is it intended to be relied upon by, any other person. Neither Northland Power Inc. nor any of its directors, officers, employees, agents or consultants has any liability whatsoever for any loss, damage or injury suffered by any third party arising out of, or in connection with, their use of this report.

1. Introduction

Northland Power Solar Abitibi L.P., Northland Power Solar Empire L.P., and Northland Power Solar Martin's Meadows L.P. (hereinafter collectively referred to as "Northland") are proposing to develop a 30-megawatt (MW) AC solar photovoltaic project titled the "Cochrane Solar Project" (hereinafter referred to as the "Project"). The Project will be developed on three separate properties (Abitibi, Empire and Martin's Meadows), each with a maximum nameplate capacity of 10-MW AC, and each with a separate OPA FIT contract.

A 21-km long, 115-kV transmission line and associated infrastructure is proposed to connect the Project to an existing 115-kV Hydro One Networks Inc. (HONI) transmission line (circuit C2H) north of Hunta, ON.

The Project was formerly submitted to the MOE as three, individual 10-MW projects known as the Abitibi Solar Project, the Empire Solar Project and the Martin's Meadows Solar Project. As the three developments are in close proximity to one another and connect to a common transmission line, they are being integrated as one Project as per Section 4(3) of Ontario Regulation 359/09.

The Abitibi and the Martin's Meadows properties are located on Glackmeyer Concession Road 8/9, in the Town of Cochrane. The Empire property is located on Glackmeyer Concession Road 6/7, in the Town of Cochrane. The 115-kV transmission line will be located primarily along opened and unopened road allowances associated with Concession 8/9 from the locations of the three solar development properties in the Town of Cochrane, through the Unorganized Township of Clute, to the connection point located north of Hunta, ON in the Unorganized Township of Calder. Some private land outside of the road allowances will be used for the transmission line, primarily associated with the movement of the line around the southern end of Lower Deception Lake, as well as for the associated infrastructure (such as transition structures and switching station).

The Project will use solar photovoltaic technology to generate electricity. Each of the three solar developments will use solar modules mounted on fixed steel supports and arranged in seven "power or inverter blocks" on each property. Each inverter block will have two inverters rated at 0.714 MW AC and one transformer. Northland will continue to consider mounting solar modules onto a solar tracking support system, however this report has been prepared assuming the use of a fixed steel support structure with modules at a fixed tilt. Electricity generated by the solar photovoltaic modules from the solar arrays will be converted from direct current (DC) to alternating current (AC) by an inverter, and subsequently stepped up from a medium voltage of 27.6 kV to 115 kV, in order to connect to the HONI transmission system via the previously described transmission line.

Northland is the proponent of the Project. The contact information is as follows:

Rob Miller
Manager, Solar Development
Northland Power Inc.
30 St. Clair Ave. West, 17th Floor
Toronto, ON M4V 3A1

Tel: 647-288-1066
Fax: 416-962-6266
Email: rob.miller@northlandpower.ca

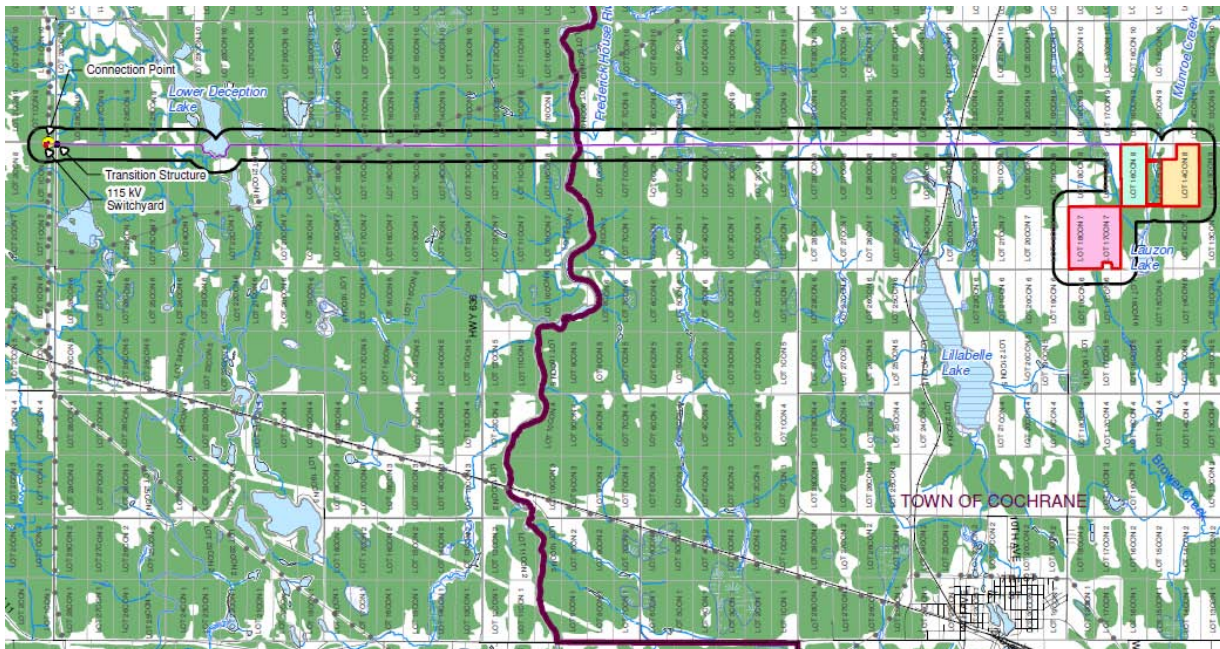
Northland has retained Hatch Ltd. (Hatch) to assist Northland in meeting the REA requirements. Contact information for Hatch is as follows:

Sean Male
REA Coordinator, Environmental Assessment & Management
4342 Queen Street, Suite 500
Niagara Falls, ON
L2E 7J7

Tel: 905-374-0701, Ext. 5280
Fax: 905-374-1157
Email: smale@hatch.ca

1.1 Project Location

The solar panels and associated equipment for the Project will be located on privately owned lands, located on Lots 14, 15, 16, Concession 8, and Lots 17, 18, Concession 7, in the Town of Cochrane. The 115-kV transmission line will be located primarily along opened and unopened road allowances associated with Concession 8/9 from the locations of the three solar development properties in the Town of Cochrane, through the Unorganized Township of Clute, to the connection point located north of Hunta, ON in the Unorganized Township of Calder. Some private land outside of the road allowances will be used for the transmission line, primarily associated with the movement of the line around the southern end of Lower Deception Lake, as well as for the associated infrastructure (such as transition structures and switching station).



1.2 Project Proponent

Northland Power develops and operates clean and green power generation projects, mainly in the provinces of Ontario and Quebec, with Saskatchewan being added to that list shortly. Their facilities produce about 900 MW of electricity. Northland has been in business since 1987, and has been publicly traded on the Toronto Stock Exchange since 1997.

Sustainability is a core value at Northland Power. All of their development efforts and operational practices focus on ensuring the ability to provide long-term benefits to their customers, investors, employees, communities and partners.

Sustainability has many dimensions for Northland Power.

- **Environmental:** Northland Power was founded on the belief that clean and green energy sources are vital to the future of our planet. Northland Power produces nothing else. Their construction and operational practices are engineered to meet the highest environmental standards, even in jurisdictions where lower standards are legislated.
- **Health and Safety:** Northland Power ensures that their staff has the knowledge, tools and time to work safely. This is Northland's first priority. Their culture of safety, respect and independence helps to ensure they attract and retain the people that they need to perform.
- **Operational:** Northland Power maintains and reinvests constantly in their operating assets to achieve maximum efficiency and economic life.
- **Community:** Northland Power takes an active interest in its host communities, to ensure they remain vibrant, healthy places to live.
- **Financial:** Northland Power consistently chooses long-term success over short-term gain. Northland Power only pursues projects that meet strict return thresholds and have creditworthy customers. As a result, they have paid stable monthly dividends since 1997.

Northland's business model is to develop, finance, construct, own and operate its facilities for the duration of the project's useful life. As such, Northland considers itself to be a member of the local community in which it operates and has a track record of being a good neighbour.

1.3 Project Benefits

Green Energy Act and Feed-in-Tariff (FIT) Program

The Ontario Government passed the "Green Energy and Green Economy Act" into law on May 14, 2009. The Act is expected to boost investment in renewable energy projects and increase conservation, creating green jobs and economic growth.

The Ontario Government lists the following objectives for the Ontario Green Energy Act:

- Spark growth in clean and renewable sources of energy such as solar, wind, hydro, biomass and biogas in Ontario.
- Create the potential for savings and better managed household energy expenditures through a series of conservation measures.
- Create 50,000 jobs for Ontarians in its first 3 years.

The FIT program was launched on October 1, 2009 to encourage use of renewable energy sources, and promote growth within the environmental industry. The Green Energy and Green Economy Act (2009) enabled the creation of the FIT program. Taken from the Program's website, the FIT program will create new jobs, boost economic activity and further the development of renewable energy technology and expertise in Ontario, while helping to phase out coal-fired electricity generation by 2014.

The Ontario Power Authority awarded 184 FIT contracts to renewable power developers in Ontario on April 8, 2010. Northland Power was awarded a total of 13 ground mount solar contracts for proposed development throughout the province. These projects are currently proceeding through the REA process.

Advantages of Solar Energy

Solar power has a multitude of advantages compared to fossil fuel powered energy plants. Most simplistically, the fuel is free. As many fossil fuels are expected to increase in price, having solar energy on the grid at a set price will give greater stability to future energy prices. Another key benefit is the lack of polluting emissions. With solar PV there are no emissions; this ensures that the surrounding local community will not have to live with poor air quality, disruptive sounds or noxious odours. Also, since solar PV is modular, it is well suited to distributed generation, meaning the power can be produced close to where it will be consumed. In addition, the solar PV systems are comprised of safe, common materials that will not affect the lands on which they are located, allowing for easy remediation upon decommissioning, unlike the vast majority of power plants.

As a source of electricity, solar PV has even more advantages when compared to other types of electricity generation. Peak power production with solar PV coincides with peak demand, during the middle of the day, reducing the need for gas fired peaking power plants.

Solar PV does not require any moving parts or water, unlike most other generation technologies, which greatly reduces its impact on the environment, its maintenance costs and its noise levels.

1.4 Project Description

Northland proposes to install ground mounted stationary photovoltaic panels which, when exposed to sunlight, will generate direct current (DC) electricity. The DC electricity will be conveyed through underground cabling to an inverter which converts the DC electricity to AC electricity. The electricity will then be conveyed to a single substation which will increase the voltage to 115 kV and a short transmission line will transfer the electricity to a connection tie-in point with the local distribution grid. The tie-in point is located west of the Project location. The construction period is estimated to be approximately 8 to 12 months in duration, with Project commissioning anticipated in the spring of 2014.

2. REA Process

Ontario Regulation (O. Reg.) 359/09 – Renewable Energy Approvals Under Part V.0.1 of the Act, (herein referred to as the REA Regulation) made under the *Environmental Protection Act* identifies the Renewable Energy Approval (REA) requirements for renewable energy projects in Ontario. The Project is considered to be a Class 3 facility, as it is ground mounted and has a nameplate capacity greater than 10 kW, and therefore requires a REA.

The REA Regulation details the required activities and reports to be completed and submitted in order to obtain the REA. The activities include Aboriginal, public, municipal and agency consultation in order to provide information on the Project to these groups and obtain feedback. Upon completion of these activities, they will be documented in the Consultation Report and submitted to the Ontario Ministry of the Environment (MOE) as part of the REA application.

The REA Regulation requires the preparation of reports, including

- Project Description Report
- Construction Plan Report
- Design and Operations Report
- Decommissioning Plan Report
- Noise Report
- Natural Heritage Records Review, Site Investigations, Evaluation of Significance and Environmental Impact Study Reports
- Water Body Records Review, Site Investigation and Environmental Impact Study Reports
- Stage 1 and 2 Archaeological Assessment Reports.

As per Sections 16 and 17 of the REA Regulation, these draft documents are to be made available to the Aboriginal communities greater than 60 days from the second Public Meeting and to the public at least 60 days from the second Public Meeting. In addition, a summary of each document is to be prepared and sent to the Aboriginal communities.

In addition, a Letter of Confirmation is to be obtained from the Ontario Ministry of Natural Resources based on their review of the Natural Heritage Reports and is to be provided to the same groups aforementioned, at the same time as the draft documents. Similarly, a Letter of Confirmation is to be obtained from the Ontario Ministry of Tourism and Culture based on their review of the Stage 1 and 2 Archaeological Assessment Reports and provided to the same groups and at the same time as the draft documents.

Also, as per Section 20 of the REA Regulation, a determination is to be made as to whether or not a heritage resource is located on the Project site and whether an assessment is required.

Therefore, this package has been prepared to meet these requirements and the reports as listed above are contained within. For clarity and ease of understanding, the Natural Heritage and Water Body Reports should be read in the order in which they appear in the list above.

2.1 Brief Summary of the Cochrane Solar Project REA Reports

A brief summary of some of the Cochrane Solar REA Reports is provided below. A description of the purpose of each of the REA Reports is provided in Figure 2, while Figure 3 provides the location of the complete summary of each REA report, along with the required confirmation letters and report on heritage considerations.

The Natural Heritage and Water Body reports have been prepared to identify potential negative environmental effects the Project may have on existing significant natural features or waterbodies, respectively.

Environmental Impact Studies have been prepared to identify potential negative environmental effects that all phases of the Project may have on the significant natural features and waterbodies. Mitigation measures have been proposed to prevent these effects from occurring or minimize the magnitude, extent, duration and frequency in the event that they do occur to an acceptable level.

Confirmation Letters from the Ontario Ministry of Natural Resources were received that confirm that the Natural Heritage reports satisfy the REA Regulation criteria.

An archaeological assessment has been conducted on the Project location which included a Stage 1 background study of past archaeological investigations and known archaeological sites within a 2-km radius of the Cochrane Solar Project location. It also included a systematic 5-m interval Stage 2 archaeological survey of all of the Leased Lands on the property. In addition, an archaeological assessment was completed for the transmission line associated with the Project

The office of the Ministry of Tourism and Culture has reviewed the Archaeological Assessment Reports in accordance with Part VI of the Ontario Heritage Act, R.S.O. 1990, c 0.18, and accepted their findings.

Research and agency consultation undertaken has not identified the need for a heritage impact assessment under Section 23 of the REA Regulation. A noise study has also been undertaken and identifies mitigation measures the project will incorporate in order to meet MOE requirements.

3. Next Steps

All the Reports and a REA Application Form will be sent to MOE for review and processing. The MOE has 6 months to review and make a decision on the Project. The MOE's decision will be posted for a 15-day review period on the Environmental Registry. Provided no appeal requests have been submitted, the Project will commence, pending receipt of all other required permits and approvals.

Figure 1: Report Name and Purpose

Report Name	Purpose
Project Description Report	Summarizes Project location, construction and operational activities, potential environmental effects and mitigation, and social and environmental benefits.
Construction Plan Report	Provides details on the construction activities, timelines, materials, temporary uses of land and waste materials generated and environmental effects, mitigation and monitoring during construction.
Design and Operations Report	Provides the site layout plan, Project components, operations and maintenance activities, communications and emergency response plan, and environmental effects monitoring plan.
Decommissioning Plan Report	Provides the activities to be undertaken during decommissioning and restoring the Project site.
Natural Heritage Records Review Report	Provides information from existing documentation on natural heritage features including wetlands, Areas of Natural and Scientific Interest and wildlife habitat.
Natural Heritage Site Investigations Report	Documents the results of the site investigations to identify and confirm natural heritage features on and within 120 m of the Project.
Natural Heritage Evaluation of Significance Report	Evaluates the significance of any natural heritage features located within 120 m of the Project.
Natural Heritage Environmental Impact Study	Identifies potential adverse environmental effects on significant natural heritage features, proposes mitigation measures to prevent or minimize adverse effects and provides monitoring program.
Water Body Records Review Report	Provides information from existing documentation on waterbodies including lakes, permanent and intermittent streams and groundwater seepage areas.
Water Body Site Investigation Report	Documents the results of the site investigations to identify and confirm water body features on and within 120 m of the Project.
Water Body Environmental Impact Study	Identifies potential adverse environmental effects on waterbodies, proposes mitigation measures to prevent or minimize adverse effects and provides monitoring program.
Stage 1 and 2 Archaeological Assessment Report	Documents the results of the Stage 1 assessment which is a desktop study identifying any archaeological potential and the Stage 2 assessment which is a site investigation confirming the archaeological potential.
Noise Study Report	Documents the results of noise modeling to identify noise emissions levels at nearby sensitive receptors and mitigation requirements to meet MOE noise emissions guidelines.

Figure 2: Appendices of Project Report Summaries

Contained as appendices to this Executive Summary are as follows:

- Appendix A: Project Description Report Summary
- Appendix B: Construction Plan Report Summary
- Appendix C: Design and Operations Report Summary
- Appendix D: Decommissioning Plan Report Summary
- Appendix E: Natural Heritage Records Review Report Summaries
- Appendix F: Natural Heritage Site Investigation Report Summaries
- Appendix G: Natural Heritage Evaluation of Significance Report Summaries
- Appendix H: Natural Heritage Environmental Impact Study Summaries
- Appendix I: Water Body Records Review Report Summaries
- Appendix J: Water Body Site Investigation Report Summaries
- Appendix K: Water Body Environmental Impact Study Summaries
- Appendix L: Stage 1 and 2 Archaeological Assessment Report Summaries
- Appendix M: Transmission Line – Stage 1 and 2 Archaeological Assessment Report Summary
- Appendix N: Noise Assessment Report Summary
- Appendix O: Protected Properties and Heritage Resource Information
- Appendix P: Letters of Confirmation – Ontario Ministry of Natural Resources
- Appendix Q: Letters of Confirmation – Ontario Ministry of Tourism and Culture

Appendix A
Project Description
Report Summary

**Northland Power Inc.
Cochrane Solar Project****Summary****Project Description Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Project Description Report for the Abitibi Solar Project.

Northland Power Solar Abitibi L.P., Northland Power Solar Empire L.P., and Northland Power Solar Martin's Meadows L.P. (hereinafter collectively referred to as "Northland") are proposing to develop a 30-megawatt (MW) AC solar photovoltaic project titled the "Cochrane Solar Project" (hereinafter referred to as the "Project"). The Project will be developed on three separate properties (Abitibi, Empire and Martin's Meadows), each with a maximum nameplate capacity of 10-MW AC, and each with a separate OPA FIT contract.

A 21-km long 115-kV transmission line and associated infrastructure is proposed to connect the Project to an existing 115-kV Hydro One Networks Inc. (HONI) transmission line (circuit C2H) north of Hunta, ON.

The Project was formerly submitted to the MOE as three, individual 10-MW projects known as the Abitibi Solar Project, the Empire Solar Project and the Martin's Meadows Solar Project. As the three developments are in close proximity to one another and connect to a common transmission line, they are being integrated as one Project as per Section 4(3) of Ontario Regulation 359/09.

The Abitibi and the Martin's Meadows properties are located on Glackmeyer Concession Road 8/9, in the Town of Cochrane. The Empire property is located on Glackmeyer Concession Road 6/7, in the Town of Cochrane. The 115-kV transmission line will be located primarily along opened and unopened road allowances associated with Concession 8/9 from the locations of the three solar development properties in the Town of Cochrane, through the Unorganized Township of Clute, to the connection point located north of Hunta, ON in the Unorganized Township of Calder. Some private land outside of the road allowances will be used for the transmission line, primarily associated with the movement of the line around the southern end of Lower Deception Lake, as well as for the associated infrastructure (such as transition structures and switching station).

The Project will use solar photovoltaic technology to generate electricity. Each of the three solar developments will use solar modules mounted on fixed steel supports and arranged in 7 "power or inverter blocks" on each property. Each inverter block will have two inverters rated at 0.714-MW AC and one transformer. Northland will continue to consider mounting solar modules onto a solar tracking support system, however this report has been prepared assuming the use of a fixed steel support structure with modules at a fixed tilt. Electricity generated by the solar photovoltaic modules from the solar arrays will be converted from direct current (DC) to alternating current (AC) by an

inverter, and subsequently stepped up from a medium voltage of 27.6 kV to 115 kV, in order to connect to the HONI transmission system via the previously described transmission line.

Table 1 of the REA Regulation requires proponents of Class 3 solar projects to prepare a Project Description Report (PDR). The PDR is prepared as one of the first Project documents once the REA process commences and is made available for public review prior to the first public meeting. The purpose of the PDR is to provide preliminary information regarding the Project to members of the public, Aboriginal groups, municipalities and other government agencies. The contents of the PDR are summarized in the following sections.

2. Summary of Project

The proposed Project consists of a 30-MW Class 3 solar facility, constructed on privately owned land in the Town of Cochrane. Northland has entered into an option to purchase agreement with the private landowner for the duration of operation. The transmission line associated with the Project will primarily be located on public land associated with municipal right-of-ways in the Town of Cochrane and the unorganized townships of Clute and Calder, though some private land will be used. Northland is currently working with the Town of Cochrane and the Ontario Ministry of Natural Resources around use of the municipal right-of-way. Where required, Northland is entering into agreements with private landowners.

Northland has obtained contracts from the Ontario Power Authority (OPA) to buy the power produced by the proposed facility under the Feed-In-Tariff (FIT) program for a period of 20 years.

Construction of the proposed facility would occur over an 8- to 12-month period with major construction activities including site preparation, access road construction, installation of solar panels (including footings, support structures and panels), installation of inverters and transformer and all electrical cabling and site rehabilitation following construction.

The facility would operate 365 d/yr, generating electricity when sufficient solar irradiation conditions exist. Inspection and maintenance activities would be conducted periodically (every 2 to 3 months) through the year, with primary activities including inspection the structures, and interconnections. The proposed facility would not consume any fuels nor produce any waste as a result of generation activities.

3. Potential Environmental Effects

The PDR summarized the existing environmental features on the Project site.

The PDR also identified preliminary potential environmental effects of the Project including

- potential erosion and sedimentation due to construction activities
- temporary loss of agricultural lands due to facility installation and operation
- removal of natural vegetation communities on the Project site
- noise emissions from the invertors and transformer.

Mitigation measures were identified to prevent or eliminate those effects. Potential effects and mitigation measures were assessed in more detail in other Project reports.

Appendix B
Construction Plan
Report Summary

**Northland Power Inc.
Cochrane Solar Project****Summary****Construction Plan Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Ontario Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Construction Plan Report for the Cochrane Solar Project.

Northland Power Solar Abitibi L.P., Northland Power Solar Empire L.P., and Northland Power Solar Martin's Meadows L.P. (hereinafter collectively referred to as "Northland") are proposing to develop a 30-megawatt (MW) AC solar photovoltaic project titled the "Cochrane Solar Project" (hereinafter referred to as the "Project"). The Project will be developed on three separate properties (Abitibi, Empire and Martin's Meadows), each with a maximum nameplate capacity of 10-MW AC, and each with a separate OPA FIT contract.

A 21-km long 115-kV transmission line and associated infrastructure is proposed to connect the Project to an existing 115-kV Hydro One Networks Inc. (HONI) transmission line (circuit C2H) north of Hunta, ON.

The Project was formerly submitted to the MOE as three, individual 10-MW projects known as the Abitibi Solar Project, the Empire Solar Project and the Martin's Meadows Solar Project. As the three developments are in close proximity to one another and connect to a common transmission line, they are being integrated as one Project as per Section 4(3) of Ontario Regulation 359/09.

The Abitibi and the Martin's Meadows properties are located on Glackmeyer Concession Road 8/9, in the Town of Cochrane. The Empire property is located on Glackmeyer Concession Road 6/7, in the Town of Cochrane. The 115-kV transmission line will be located primarily along opened and unopened road allowances associated with Concession 8/9 from the locations of the three solar development properties in the Town of Cochrane, through the Unorganized Township of Clute, to the connection point located north of Hunta, ON in the Unorganized Township of Calder. Some private land outside of the road allowances will be used for the transmission line, primarily associated with the movement of the line around the southern end of Lower Deception Lake, as well as for the associated infrastructure (such as transition structures and switching station).

The Project will use solar photovoltaic technology to generate electricity. Each of the three solar developments will use solar modules mounted on fixed steel supports and arranged in 7 "power or inverter blocks" on each property. Each inverter block will have two inverters rated at 0.714 MW AC and one transformer. Northland will continue to consider mounting solar modules onto a solar tracking support system, however this report has been prepared assuming the use of a fixed steel support structure with modules at a fixed tilt. Electricity generated by the solar photovoltaic modules

from the solar arrays will be converted from direct current (DC) to alternating current (AC) by an inverter, and subsequently stepped up from a medium voltage of 27.6 kV to 115 kV, in order to connect to the HONI transmission system via the previously described transmission line.

2. Construction

The construction process of the Project consists of four phases:

- Phase 1 – Site Preparation
- Phase 2 – Construction and Installation of Plant
- Phase 3 – Testing and Commissioning
- Phase 4 – Site Restoration.

The site work is scheduled to start at the beginning of 2013 and have an estimated 8- to 12-month construction period.

2.1 Phase 1 - Site Preparation

Site preparation refers to all necessary activities prior to the construction of foundations, substation, and installation of the PV modules. It includes surveying/staking, site clearing and grubbing, construction of access roads and drainage systems, installation of security gate and fencing, and construction of staging areas.

The site preparation work is forecasted to take place in mid-2013.

2.2 Phase 2 - Construction and Installation of Plant

Construction and installation of the facility consists of building foundations, trenches for cabling, structural support and finally installation of the panels on the structural support. The substation and associated electrical equipment will also be installed. This includes the underground and above ground cabling on the Project site. In addition, an overhead transmission line to transmit power from the Project substation to the local distribution network will be installed.

The construction and installation of the plant is forecasted to take place from mid-2013 to mid-2014.

2.3 Phase 3 – Testing and Commissioning

Testing and commissioning will be performed on the installation prior to start-up and connection to the power grid. Solar modules, inverters, collection system, and substation will be checked for system continuity, reliability, and performance standards. If problems or issues are identified, modifications will be made prior to start-up.

2.4 Phase 4 – Site Restoration

Site restoration will be applicable for the entire Project location. The main objective will be to reinstate the area to the original pre-construction condition, such as the ecosystem, vegetation, and drainage. All construction material, equipment, temporary facilities, and waste will be removed from the site. Topsoil will be backfilled where required, including landscaping to achieve proper drainage. Revegetation will include planting of native plants and hydro-seeding where required.

The revegetation where possible is forecasted to take place in Spring 2014.

3. Environmental Effects

Environmental effects and proposed mitigation measures are summarized in the table below.

Environmental Feature	Anticipated Impact	Proposed Mitigation
Soils	Negative effects on soil quality, loss of soils due to erosion and soil compaction.	Erosion and sedimentation control measures will be implemented and soil loosening measures could be applied, if necessary.
Groundwater	Pumping of groundwater could lower water table locally.	Limited impacts due to the duration of pumping (e.g., only during excavations). Any pumped water will be treated.
Surface Water Quality	Surface water quality could be impacted by erosion/ sedimentation of excavated or exposed soils, erosion caused by increased runoff from impervious or less pervious areas, or deposition of fugitive dust.	Erosion and sedimentation control measures, spill prevention and response plan, air quality measures will all mitigate impacts
Aquatic Habitat and Biota	Limited impacts, as a 30-m setback from all watercourses. Adverse effects possible due to access road/ transmission line/fence crossings.	Construction of the transmission line crossings will follow <i>Fisheries and Oceans Canada's (DFO) Ontario Operational Statement for Overhead Line Construction (DFO, 2007) guidelines</i> . Access road/fence crossings to follow best management practices for work in water.
Vegetation	Minor removal of vegetation and shrubs/trees to occur. Dust deposition and spills could also impact vegetation.	In order to minimize potential losses from surrounding vegetation communities, areas where clearing is required will be well marked, and workers will be instructed not to enter areas of natural vegetation.
Wildlife	Impacts to wildlife could occur as a result of loss of habitat, disturbance from construction activities, or incidental mortality as a result of collision with construction vehicles.	In order to minimize the potential for habitat loss, work areas will be demarcated in order to ensure that the contractor does not work beyond those bounds. In order to minimize potential for disturbance or incidental take of wildlife, major construction activities (such as land grading and woodland clearing) will be timed outside of the breeding bird period (generally May through July), wherever possible. Vegetation ground cover to be used on the Project location will be selected in consideration of promotion of wildlife features.

Environmental Feature	Anticipated Impact	Proposed Mitigation
Air Quality and Noise	Dust may become airborne from vehicular traffic, heavy machinery use, and soil moving activities. Dust in the air can have a range of effects including, but not limited to: impacts on human health as a result of irritation to lungs, eyes, etc, which could impact construction workers or nearby residents, impacts on surface water quality and aquatic habitat if the dust is deposited into waterbodies, impacts on vegetation if heavy dust loads build up on photosynthetic surfaces, thereby resulting in mortality of the plants.	These mitigation measures are to include, as required, use of dust suppression (i.e., water) on exposed areas including access roads, stockpiles and work/laydown areas as necessary, hard surfacing (addition of coarse rock) of access roads or other high-traffic work areas, phased construction, where possible, to limit the amount of time soils are exposed, avoid earth-moving works during excessively windy weather. Stockpiles to be worked (e.g., loaded/unloaded) from the downwind side to minimize wind erosion, stockpiles and other disturbed areas to be stabilized as necessary (e.g., taped, mulched, graded, revegetated or watered to create a hard surface crust) to reduce/prevent erosion and escape of fugitive dust, dust curtain to be used on loaded dump trucks delivering materials from off site).
Noise	Construction and installation activities have the potential to result in increased noise levels on and within the vicinity of the Project location.	Construction and installation activities that produce a large amount of noise will be limited to daylight hours. Vehicles will also be regularly checked for properly working mufflers or other noise reducing equipment, and all construction equipment will meet MOE emission standards.
Traffic	Increased traffic volumes, equipment delivery to the Project location, and temporary disruption along routes utilized by construction vehicles or during construction of the transmission line may result in occasional delays to local community traffic flow during the construction period.	Mitigation measures include: designated transportation routes will be utilized; a police or security escort will be utilized to guide or accompany major equipment deliveries to the Project location if necessary; flagmen will be utilized as required to facilitate traffic flow and control if necessary; construction vehicles will be driven in a proper manner with respect for all traffic laws, signage providing any detour directions will be prominently displayed, vehicle imprints or erosion gullies will be repaired or regraded as necessary.
Roadways	The use of local roadways by construction vehicle traffic may result in some minor damage to roadways during the construction of the Project, given their proximity to the Project location.	Mitigation measures include: designated and appropriate transportation routes will be utilized; construction vehicles will be driven in a proper manner with respect for all traffic laws; roadways will be photographed prior to construction and damage to local roadways, above and beyond normal wear and tear, will be repaired as necessary.

Environmental Feature	Anticipated Impact	Proposed Mitigation
Public and Construction Site Safety	Construction of the proposed development poses potential public and construction site safety concerns in the vicinity of the Project location.	Mitigation measures include: public access to the construction area will be prevented through the use of fences, gates, and security procedures; signage will be posted to notify the public of construction in the area; workers will be required to adhere to prescribed safety procedures; proper procedures for construction traffic will be developed, where required.
Waste Management	Construction activities will likely result in the generation of recyclable material, as well as construction and sanitary waste.	Mitigation measures include, construction waste will be properly stored on site prior to disposal off site at local, registered disposal facilities, all sanitary waste is to be contained and hauled off site by a designated hauler throughout the construction period, hazardous wastes will be properly stored in secure containers inside impervious berms or other containment areas until disposal off site at a registered facility, reuse and recycling will be practiced wherever possible.
Land Use	Lands within the Project location will be removed from agricultural production upon Project construction.	Land use could be retained upon completion of the Project.
Protected Properties	No protected properties, as defined in Section 19(1) of O. Reg. 359/09, exist in the vicinity of the Project location.	N/A
Built Heritage and Cultural Heritage Landscapes	No negative effects to built heritage and cultural heritage landscapes are anticipated as no potential impacts to the resources were identified.	N/A
Archaeological Resources	A Stage 1 and 2 Archaeological Assessment was conducted for the Project location. No archaeological materials were identified.	N/A
Spills	Spills of petroleum hydrocarbon materials from vehicles/ equipment operating on site, such as fuel or hydraulic oils, or spills of concrete materials from concrete trucks, could occur during the construction process.	Best management practices shall be implemented, including but not limited to: all refuelling and equipment maintenance activities will be conducted at specified locations; equipment is to be monitored to ensure it is well maintained and free of leaks; spill containment and clean-up supplies are to be maintained on site at all times; spills will be cleaned up immediately and reported accordingly.

4. Conclusion

Weekly inspections will ensure conformance with environmental mitigation measures. Overall, no adverse impact to the environment is anticipated when the mitigation measures are implemented.

Appendix C
Design and Operations
Report Summary

**Northland Power Inc.
Cochrane Solar Project****Summary****Design and Operation Plan Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Ontario Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Design and Operation Plan Report for the Cochrane Solar Project.

Northland Power Solar Abitibi L.P., Northland Power Solar Empire L.P., and Northland Power Solar Martin's Meadows L.P. (hereinafter collectively referred to as "Northland") are proposing to develop a 30-megawatt (MW) AC solar photovoltaic project titled the "Cochrane Solar Project" (hereinafter referred to as the "Project"). The Project will be developed on three separate properties (Abitibi, Empire and Martin's Meadows), each with a maximum nameplate capacity of 10-MW AC, and each with a separate OPA FIT contract.

A 21-km long 115-kV transmission line and associated infrastructure is proposed to connect the Project to an existing 115-kV Hydro One Networks Inc. (HONI) transmission line (circuit C2H) north of Hunta, ON.

The Project was formerly submitted to the MOE as three, individual 10-MW projects known as the Abitibi Solar Project, the Empire Solar Project and the Martin's Meadows Solar Project. As the three developments are in close proximity to one another and connect to a common transmission line, they are being integrated as one Project as per Section 4(3) of Ontario Regulation 359/09.

The Abitibi and the Martin's Meadows properties are located on Glackmeyer Concession Road 8/9, in the Town of Cochrane. The Empire property is located on Glackmeyer Concession Road 6/7, in the Town of Cochrane. The 115-kV transmission line will be located primarily along opened and unopened road allowances associated with Concession 8/9 from the locations of the three solar development properties in the Town of Cochrane, through the Unorganized Township of Clute, to the connection point located north of Hunta, ON in the Unorganized Township of Calder. Some private land outside of the road allowances will be used for the transmission line, primarily associated with the movement of the line around the southern end of Lower Deception Lake, as well as for the associated infrastructure (such as transition structures and switching station).

The Project will use solar photovoltaic technology to generate electricity. Each of the three solar developments will use solar modules mounted on fixed steel supports and arranged in 7 "power or inverter blocks" on each property. Each inverter block will have two inverters rated at 0.714 MW AC and one transformer. Northland will continue to consider mounting solar modules onto a solar tracking support system, however this report has been prepared assuming the use of a fixed steel support structure with modules at a fixed tilt. Electricity generated by the solar photovoltaic modules from the solar arrays will be converted from direct current (DC) to alternating current (AC) by an

inverter, and subsequently stepped up from a medium voltage of 27.6 kV to 115 kV, in order to connect to the HONI transmission system via the previously described transmission line.

2. Facility Components

Facility components consist of security gate, fencing and lighting, access roads, drainage systems, foundations, trenches for cabling and instrumentation control, structural support and temporary construction staging area. The Project is designed to generate a combined 30-MW (AC), by using seven blocks of photovoltaic modules totalling 10-MW AC on each property,. It should be noted that the proposed preliminary layout for the Empire property contains a greater number of blocks of photovoltaic modules than required to allow for greater flexibility during detailed design. Each block has a nominal capacity of 1.428 MW and is comprised of two sub-arrays, each with one inverter with a nominal capacity of 714 kW. The modules, inverters, intermediate transformers, AC switch, main step-up transformer, and the equipment control and monitoring system are the main electrical components of a solar facility.

3. Facility Operation Plan

The Project does not require any permanent on-site operator as it will be operated remotely. For general monitoring and maintenance purposes, intermittent/regular basis local personnel may be hired and will be dispatched from a central operations office as needed. Any damage or faults with the PV modules and electrical systems will be alerted to staff remotely and repaired (or replaced) by facility staff or qualified professionals. Access to each of the properties will be limited to Project personnel.

3.1 Maintenance

The weather conditions, such as the quantity and frequency of rain and snow at the Project location will determine the frequency of cleaning. At the very most, it is expected that the modules will require cleaning quarterly, but it is possible cleaning the modules will not be necessary at all. If required, water trucks will bring water to the site to supply the water required.

The transformers will be visually inspected on a monthly basis and their status recorded. Any leaks will be repaired immediately. Spill response equipment will be left on site or in the maintenance trucks should leaks be observed. The site will also be visually inspected for any erosion or sedimentation issues and remediation will be implemented as necessary to prevent environmental impacts.

3.2 Environmental Effects Monitoring Plan

The Project Environmental Effects Monitoring Plan will be implemented through all phases of the Project. The purpose of the plan is to ensure that performance objectives and mitigation measures are working as designed to mitigate negative impacts. As well, it provides additional measures, if primary measures are not functioning. Table 5.2 in the Design and Operations Report provides the details of the proposed monitoring plan to monitor the impacts to the natural and social environments.

3.3 Emergency Response Plan

The Project Emergency Response Plan will be implemented through all phases of the Project. The purpose of the plan is to establish and maintain emergency procedures required for effectively responding to accidents and other emergency situations, and for minimizing associated losses. The

Plan provides the emergency response and communications procedures to be used in response to these three potential emergency scenarios (i.e., fire, personal injury and spills).

All Project personnel will be trained in emergency response and communications procedures.

Appendix D
Decommissioning Plan
Report Summary

**Northland Power Inc.
Cochrane Solar Project****Summary****Decommissioning Plan Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Ontario Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Decommissioning Plan Report for the Cochrane Solar Project.

Northland Power Solar Abitibi L.P., Northland Power Solar Empire L.P., and Northland Power Solar Martin's Meadows L.P. (hereinafter collectively referred to as "Northland") are proposing to develop a 30-megawatt (MW) AC solar photovoltaic project titled the "Cochrane Solar Project" (hereinafter referred to as the "Project"). The Project will be developed on three separate properties (Abitibi, Empire and Martin's Meadows), each with a maximum nameplate capacity of 10-MW AC, and each with a separate OPA FIT contract.

A 21-km long 115-kV transmission line and associated infrastructure is proposed to connect the Project to an existing 115-kV Hydro One Networks Inc. (HONI) transmission line (circuit C2H) north of Hunta, ON.

The Project was formerly submitted to the MOE as three, individual 10-MW projects known as the Abitibi Solar Project, the Empire Solar Project and the Martin's Meadows Solar Project. As the three developments are in close proximity to one another and connect to a common transmission line, they are being integrated as one Project as per Section 4(3) of Ontario Regulation 359/09.

The Abitibi and the Martin's Meadows properties are located on Glackmeyer Concession Road 8/9, in the Town of Cochrane. The Empire property is located on Glackmeyer Concession Road 6/7, in the Town of Cochrane. The 115-kV transmission line will be located primarily along opened and unopened road allowances associated with Concession 8/9 from the locations of the three solar development properties in the Town of Cochrane, through the Unorganized Township of Clute, to the connection point located north of Hunta, ON in the Unorganized Township of Calder. Some private land outside of the road allowances will be used for the transmission line, primarily associated with the movement of the line around the southern end of Lower Deception Lake, as well as for the associated infrastructure (such as transition structures and switching station).

The Project will use solar photovoltaic technology to generate electricity. Each of the three solar developments will use solar modules mounted on fixed steel supports and arranged in 7 "power or inverter blocks" on each property. Each inverter block will have two inverters rated at 0.714-MW AC and one transformer. Northland will continue to consider mounting solar modules onto a solar tracking support system, however this report has been prepared assuming the use of a fixed steel support structure with modules at a fixed tilt. Electricity generated by the solar photovoltaic modules

from the solar arrays will be converted from direct current (DC) to alternating current (AC) by an inverter, and subsequently stepped up from a medium voltage of 27.6 kV to 115 kV, in order to connect to the HONI transmission system via the previously described transmission line.

It is anticipated that the Project will have a useful lifetime of at least 20 years, which can be extended with proper maintenance, component replacement and repowering. It is assumed that the Project will be decommissioned after the 20-yr power purchase agreement with the Ontario Power Authority concludes.

2. Decommissioning Activities

2.1 Equipment Dismantling and Removal

All decommissioning of electrical devices, equipment, and wiring/cablings will be in accordance with local, municipal, provincial and federal agencies standards and guidelines. Any electrical decommissioning will include obtaining the required permits and following lockout/tag out procedures before de-energizing, isolating, and disconnecting electrical devices, equipment and wiring/cablings.

2.2 Site Restoration

The proposed Project areas will be restored to its pre-development state, subject to environmental requirements and the wishes of the landowner. The following will be undertaken:

- any trenches/drains excavated will be filled with suitable materials and leveled
- any roads or embankments will be removed completely, filled with suitable sub-grade material and leveled
- any compacted ground will be tilled, mixed with suitable sub-grade materials and leveled
- any damage to any existing tile drainage system, where present, caused by the Project will be repaired/restored
- prepared soil, with all the nutrients required by the crop to grow, will be spread wherever necessary.

2.3 Management of Waste and Excess Materials

All waste and excess materials will be disposed of in accordance with municipal, provincial and federal regulations. Waste that requires disposal will be disposed of in a provincially licensed facility by a provincially licensed hauler. Although hazardous waste is not anticipated on site (with the exception of the aforementioned transformer oil), any hazardous waste will be removed from site and disposed of in accordance with federal, provincial and municipal requirements.

2.4 Emergency Response

The Project Emergency Response Plan will be implemented through all phases of the Project. The purpose of the plan is to establish and maintain emergency procedures required for effectively responding to accidents and other emergency situations, and for minimizing associated losses. The Plan provides the emergency response and communications procedures to be used in response to these three potential emergency scenarios (i.e., fire, personal injury and spills).

All Project personnel will be trained in the emergency response and communications procedures.

3. Restoration of Land Negatively Affected by the Project

Following decommissioning of the Project, if any lands or water features are negatively affected by the Project, Northland is committed to restoring the site as close to its pre-construction state as feasible. This would be subject to environmental requirements and wishes of the landowner.

Appendix E
Natural Heritage
Records Review Report Summaries

**Northland Power Inc.
Abitibi Solar Project****Summary****Natural Heritage Records Review Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Natural Heritage Records Review Report for the Abitibi Solar Project.

Northland Power Solar Abitibi L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the District of Cochrane, titled the Abitibi Solar Project (hereinafter referred to as the “Project”). The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the “solar panel Project location.” The solar panel Project location is approximately 98 hectares (ha) in size and located on Lots 14 and 15, Concession 8 of the Town of Cochrane on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20-km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 25 of the REA Regulation requires proponents of Class 3 solar projects to undertake a Natural Heritage Records Review. Records were searched within a minimum distance of 1 km from the Project site from Ministry of Natural Resources (MNR), federal government, Town of Cochrane, Cochrane Suburban Planning Board and other relevant sources.

2. Results

Key natural features and points of interest identified during the records review include the following:

- There are no Provincial Parks, Areas of Natural and Scientific Interest or wetlands on or within 120 m of the Solar Panel Project Location
- There are several wetlands location within 120 m of the Transmission Line Project Location.
- Ranges of several species of conservation concern, including species of birds, amphibians and mammals, overlap the Project area and suitable habitat may be found.

3. Conclusions

Table 3.1 summarizes the results of the records review.

Table 3.1 Summary of Records Review Determinations

Determination to be Made	Yes/No	Description
Is the Project in or within 120 m of a provincial park or conservation reserve?	No	The nearest such features are located more than 120 m away from the Project location (both solar panel and transmission line).
Is the Project in a natural feature?	Yes	There are wetland communities identified along the transmission line Project location. Though no confirmed wildlife habitats exist on the Project location (both solar panel and transmission line) within the records, there exists potential for habitat of species of conservation concern on the Project location (both solar panel and transmission line).
Is the Project within 50 m of an ANSI (earth science)?	No	The nearest earth science ANSI is located several kilometres from the Project location (both solar panel and transmission line).
Is the Project within 120 m of a natural feature that is not an ANSI (earth science)?	Yes	There are wetlands located within 120 m of the transmission line Project location. Though no confirmed wildlife habitats exist within 120 m of the Project location (both solar panel and transmission line) within the records, there exists potential for habitat of species of conservation concern on the Project location (both solar panel and transmission line).

As per Section 26 of the REA Regulation, a site investigation will be required to confirm the features identified during this records review. The site investigation will (i) identify if any corrections to the information presented herein are required, (ii) determine whether any additional natural features exist on or adjacent to the Project location, (iii) confirm the boundaries of the natural features within 120 m of the Project, and iv) determine the distance from the Project to the natural feature boundary.

**Northland Power Inc.
Empire Solar Project****Summary****Natural Heritage Records Review Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Natural Heritage Records Review Report for the Empire Solar Project.

Northland Power Solar Empire L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the Town of Cochrane. This Project, known as the Empire Solar Project, is hereafter referred to as the “Project.” The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the “solar panel Project location”. The solar panel Project location is approximately 122 hectares (ha) in size and located on Lots 17 and 18, Concession 7 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 7.

The second part of the Project is the approximately 20 km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 25 of the REA Regulation requires proponents of Class 3 solar projects to undertake a Natural Heritage Records Review. Records were searched within a minimum distance of 1 km from the Project site from Ministry of Natural Resources (MNR), federal government, Town of Cochrane, Cochrane Suburban Planning Board and other relevant sources.

2. Results

Key natural features and points of interest identified during the records review include the following:

- There are no Provincial Parks, Areas of Natural and Scientific Interest or wetlands on or within 120 m of the Solar Panel Project Location.
- A single wetland community was identified within 120 m west of the solar panel Project Location.
- There are several wetlands located within 120 m of the Transmission Line Project Location.
- Ranges of several species of conservation concern, including species of birds, amphibians and mammals, overlap the Project area and suitable habitat may be found.

3. Conclusions

Table 3.1 summarizes the results of the records review.

Table 3.1 Summary of Records Review Determinations

Determination to be Made	Yes/No	Description
Is the Project in or within 120 m of a provincial park or conservation reserve?	No	The nearest such features are located more than 120 m away from the Project location (both solar panel and transmission line).
Is the Project in a natural feature?	Yes	There are wetland communities identified along the transmission line Project location. Though no confirmed wildlife habitats exist on the Project location (both solar panel and transmission line) within the records, there exists potential for habitat of species of conservation concern on the Project location (both solar panel and transmission line).
Is the Project within 50 m of an ANSI (earth science)?	No	The nearest earth science ANSI is located several kilometres from the Project location (both solar panel and transmission line).
Is the Project within 120 m of a natural feature that is not an ANSI (earth science)?	Yes	There are wetlands located within 120 m of the transmission line Project location. Though no confirmed wildlife habitats exist within 120 m of the Project location (both solar panel and transmission line) within the records, there exists potential for habitat of species of conservation concern on the Project location (both solar panel and transmission line).

As per Section 26 of the REA Regulation, a site investigation will be required to confirm the features identified during this records review. The site investigation will (i) identify if any corrections to the information presented herein are required, (ii) determine whether any additional natural features exist on or adjacent to the Project location, (iii) confirm the boundaries of the natural features within 120 m of the Project, and (iv) determine the distance from the Project to the natural feature boundary.

**Northland Power Inc.
Martin's Meadows Solar Project
Summary**

Natural Heritage Records Review Report

1. Introduction

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Natural Heritage Records Review Report for the Martin's Meadows Solar Project.

Northland Power Solar Martin's Meadows L.P. (hereinafter referred to as "Northland") is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic facility in the Town of Cochrane. This Project, known as the Martin's Meadows Solar Project, is hereafter referred to as "Martin's Meadows" or the "Project." The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the "solar panel Project location". The solar panel Project location is approximately 82 hectares (ha) in size and located on Lot 16, Concession 8 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20 km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 25 of the REA Regulation requires proponents of Class 3 solar projects to undertake a Natural Heritage Records Review. Records were searched within a minimum distance of 1 km from the Project site from Ministry of Natural Resources (MNR), federal government, Town of Cochrane, Cochrane Suburban Planning Board and other relevant sources.

2. Results

Key natural features and points of interest identified during the records review include the following:

- There are no Provincial Parks, Areas of Natural and Scientific Interest or wetlands on or within 120 m of the Solar Panel Project Location.
- A single wetland community was identified within 120 m west of the solar panel Project Location.
- There are several wetlands location within 120 m of the Transmission Line Project Location.
- Ranges of several species of conservation concern, including species of birds, amphibians and mammals, overlap the Project area and suitable habitat may be found.

3. Conclusions

Table 3.1 summarizes the results of the records review.

Table 3.1 Summary of Records Review Determinations

Determination to be Made	Yes/No	Description
Is the Project in or within 120 m of a provincial park or conservation reserve?	No	The nearest such features are located more than 120 m away from the Project location.
Is the Project in a natural feature?	Yes	There are wetland communities identified along the transmission line Project location. Though no confirmed wildlife habitats exist on the Project location (both solar panel and transmission line) within the records, there exists potential for habitat of species of conservation concern on the Project location (both solar panel and transmission line).
Is the Project within 50 m of an ANSI (earth science)?	No	The nearest earth science ANSI is located several kilometres from the Project location (both solar panel and transmission line).
Is the Project within 120 m of a natural feature that is not an ANSI (earth science)?	Yes	There are wetlands located within 120 m of the transmission line Project location. Though no confirmed wildlife habitats exist within 120 m of the Project location (both solar panel and transmission line) within the records, there exists potential for habitat of species of conservation concern on the Project location (both solar panel and transmission line).

As per Section 26 of the REA Regulation, a site investigation will be required to confirm the features identified during this records review. The site investigation will (i) identify if any corrections to the information presented herein are required, (ii) determine whether any additional natural features exist on or adjacent to the Project location, (iii) confirm the boundaries of the natural features within 120 m of the Project, and iv) determine the distance from the Project to the natural feature boundary.

Appendix F
Natural Heritage
Site Investigation Report Summaries

**Northland Power Inc.
Abitibi Solar Project****Summary****Natural Heritage Site Investigations Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Natural Heritage Site Investigations Report for the Abitibi Solar Project.

Northland Power Solar Abitibi L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the District of Cochrane, titled the Abitibi Solar Project (hereinafter referred to as the “Project”). The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the “solar panel Project location.” The solar panel Project location is approximately 98 hectares (ha) in size and located on Lots 14 and 15, Concession 8 of the Town of Cochrane on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20-km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 26 of the REA Regulation requires proponents of Class 3 solar projects to undertake a Natural Heritage Site Investigation for the purpose of determining if the information provided in the Natural Heritage Records Review Report is correct, if any additional natural heritage features are present within 120 m of the Project, and if the borders and distance of the natural heritage features from the Project site are correct. To obtain this information a site visit was completed. If any features are located within the specified setbacks, an Evaluation of Significance is required.

2. Results

Upland vegetation communities identified on and within 120 m of the Solar Panel Project Location consist of the following:

- Agricultural lands consisting of pasturelands/hayfields, or recently ploughed lands (for archaeological surveys)
- ES1 – Coniferous stands dominated by black spruce and jack pine
- ES6 – Mixedwood stands of trembling aspen and black or white spruce

- ES7 – Hardwood stands of trembling aspen and white birch
- ES9 – Coniferous stands dominated by black or white spruce
- ES10 – Hardwood dominated mixedwood stands of trembling aspen, black spruce and balsam poplar
- ES11 – Black spruce stands on organic soil
- ES12 – Black spruce and larch stands on organic soil
- ES13 – Black spruce and larch or white cedar stands on organic soil.

The Significant Wildlife Habitat Technical Guide (SWHTG) (MNR, 2000) identifies four main types of wildlife habitat that can be classified as significant:

- habitat for seasonal concentrations of animals
- rare or specialized habitats for wildlife
- habitat for species of conservation concern
- wildlife movement corridors.

Several candidate significant wildlife habitats were identified on and within 120 m of the Solar Panel Project location, including

- habitat for species of conservation concern (Common Nighthawk, Canada Warbler, Olive-sided Flycatcher, *Carex haydenii*, *Carex wiegandii*, *Vaccinium ovalifolium*)
- seasonal concentration areas (winter deer yards/moose late winter habitat, waterfowl stopover and staging areas and waterfowl nesting sites)
- specialized habitat for wildlife (habitat for area sensitive species)
- animal movement corridors.

Several candidate significant wildlife habitats were identified on and within 120 m of the Transmission Line Project location, including

- seasonal concentration areas (winter deer yards/moose late winter habitat, waterfowl stopover and staging areas and waterfowl nesting sites.)
- specialized habitat for wildlife (habitat for area sensitive species, moose aquatic feeding areas, old growth or mature forest stands, woodlands supporting amphibian breeding habitat, wetlands supporting amphibian breeding habitat, mink, otter, marten and fisher denning sites, specialized raptor nesting habitat and seeps and springs.)
- habitat for species of conservation concern (Northern Long-eared Bat, Red-necked Grebe, Black Tern, Short-eared Owl, Common Nighthawk, Canada Warbler, Bald Eagle and Olive-sided Flycatcher, *Carex haydenii*, *Carex wiegandii*, *Vaccinium ovalifolium*)
- animal movement corridors.

3. Conclusions

Therefore, some components of the Project are located within 120 m of a natural feature (i.e., wildlife habitat and wetlands). As per Section 27 of the REA Regulation, an Evaluation of Significance is required to determine if these natural features are significant.

**Northland Power Inc.
Empire Solar Project****Summary****Natural Heritage Site Investigations Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Natural Heritage Site Investigations Report for the Empire Solar Project.

Northland Power Solar Empire L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the Town of Cochrane. This Project, known as the Empire Solar Project, is hereafter referred to as the “Project.” The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the “solar panel Project location”. The solar panel Project location is approximately 122 hectares (ha) in size and located on Lots 17 and 18, Concession 7 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 7.

The second part of the Project is the approximately 20 km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 26 of the REA Regulation requires proponents of Class 3 solar projects to undertake a Natural Heritage Site Investigation for the purpose of determining if the information provided in the Natural Heritage Records Review Report is correct, if any additional natural heritage features are present within 120 m of the Project, and if the borders and distance of the natural heritage features from the Project site are correct. To obtain this information a site visit was completed. If any features are located within the specified setbacks, an Evaluation of Significance is required.

2. Results

There were several wetland communities identified during the site investigations on and within 120 m of the Project location, many of which were previously unidentified during the records review stage. Upland vegetation community identified on or within 120 m of the Project location included the following:

- Agricultural lands consisting of pasturelands/hayfields, or recently ploughed lands (for archaeological surveys).
- ES1 – Coniferous stands dominated by black spruce and jack pine.

- ES6 – Mixedwood stands of trembling aspen and black or white spruce.
- ES7 – Hardwood stands of trembling aspen and white birch.
- ES9 – Coniferous stands dominated by black or white spruce.
- ES10 – Hardwood dominated mixedwood stands of trembling aspen, black spruce and balsam poplar.
- ES11 – Black spruce stands on organic soil.
- ES12 – Black spruce and larch stands on organic soil.
- ES13 – Black spruce and larch or white cedar stands on organic soil.

The Significant Wildlife Habitat Technical Guide (SWHTG) (MNR, 2000) identifies four main types of wildlife habitat that can be classified as significant:

- habitat for seasonal concentrations of animals
- rare or specialized habitats for wildlife
- habitat for species of conservation concern
- wildlife movement corridors.

Several candidate significant wildlife habitats were identified on and within 120 m of the Solar Panel Project location, including

- habitat for species of conservation concern (Common Nighthawk, Olive-sided Flycatcher, *Vaccinium ovalifolium*, *Scirpus heterochaetus*, *Carex wiegandii*, *Carex tetanica*, *Carex loliacea* and *Carex haydenii*)
- specialized habitat for wildlife (habitat for area sensitive species)

Several candidate significant wildlife habitats were also identified on and within 120 m of the Transmission Line Project location, including

- seasonal concentration areas (winter deer yards/moose late winter habitat, waterfowl stopover and staging areas and waterfowl nesting sites)
- specialized habitat for wildlife (habitat for area-sensitive species, moose aquatic feeding areas, old growth or mature forest stands, woodlands supporting amphibian breeding habitat, wetlands supporting amphibian breeding habitat, mink, otter, marten and fisher denning sites, specialized raptor nesting habitat, seeps and springs)
- habitat for species of conservation concern (Northern Long-eared Bat, Red-necked Grebe, Short-eared Owl, Common Nighthawk, Canada Warbler, Bald Eagle and Olive-sided Flycatcher, *Carex haydenii*, *Carex wiegandii*, *Vaccinium ovalifolium*)
- animal movement corridors associated with watercourses.

3. Conclusions

Therefore, some components of the Project are located within 120 m of a natural feature (i.e., wildlife habitat and wetlands). As per Section 27 of the REA Regulation, an Evaluation of Significance is required to determine if these natural features are significant.

**Northland Power Inc.
Martin's Meadows Solar Project**

Summary

Natural Heritage Site Investigations Report

1. Introduction

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Natural Heritage Site Investigations Report for the Martin's Meadows Solar Project.

Northland Power Solar Martin's Meadows L.P. (hereinafter referred to as "Northland") is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic facility in the Town of Cochrane. This Project, known as the Martin's Meadows Solar Project, is hereafter referred to as "Martin's Meadows" or the "Project." The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the "solar panel Project location". The solar panel Project location is approximately 82 hectares (ha) in size and located on Lot 16, Concession 8 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20-km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 26 of the REA Regulation requires proponents of Class 3 solar projects to undertake a Natural Heritage Site Investigation for the purpose of determining if the information provided in the Natural Heritage Records Review Report is correct, if any additional natural heritage features are present within 120 m of the Project, and if the borders and distance of the natural heritage features from the Project site are correct. To obtain this information a site visit was completed. If any features are located within the specified setbacks, an Evaluation of Significance is required.

2. Results

There is one wetland community identified during the site investigations on and within 120 m of the solar panel Project location, portions of which were previously unidentified during the records review stage. In addition, wetland communities were identified during the site investigations within 120 m of the transmission line Project location.

Upland vegetation community identified on or within 120 m of the Project location included the following:

- Solar Panel Project Location
 - ◆ Agricultural lands consisting of pasturelands/hayfields, or recently ploughed lands
 - ◆ ES6m – Trembling Aspen-Black Spruce-Balsam Fir – Medium Soil
 - ◆ MEGM3-8 – Reed Canary Grass Graminoid Meadow Type
- Transmission Line Project Location
 - ◆ Agricultural lands consisting of pasturelands/hayfields
 - ◆ ES1 – Coniferous stands dominated by black spruce and jack pine
 - ◆ ES6 – Mixedwood stands of trembling aspen and black or white spruce
 - ◆ ES7 – Hardwood stands of trembling aspen and white birch
 - ◆ ES9 – Coniferous stands dominated by black or white spruce
 - ◆ ES10 – Hardwood dominated mixedwood stands of trembling aspen, black spruce and balsam poplar
 - ◆ ES11 – Black spruce stands on organic soil
 - ◆ ES12 – Black spruce and larch stands on organic soil
 - ◆ ES13 – Black spruce and larch or white cedar stands on organic soil.

The Significant Wildlife Habitat Technical Guide (SWHTG) (MNR, 2000) identifies four main types of wildlife habitat that can be classified as significant:

- habitat for seasonal concentrations of animals
- rare or specialized habitats for wildlife
- habitat for species of conservation concern
- wildlife movement corridors.

Several candidate significant wildlife habitats were identified on and within 120 m of the Solar Panel Project location, including

- seasonal concentration areas (winter deer yards/moose late winter habitat, waterfowl stopover and staging areas, waterfowl nesting sites)
- habitat for species of conservation concern (Common Nighthawk, Olive-sided Flycatcher, *Vaccinium ovalifolium*, *Scirpus heterochaetus*, *Carex wiegandii*, and *Carex haydenii*)
- specialized habitat for wildlife (area-sensitive shrubland species)
- animal movement corridor

Several candidate significant wildlife habitats were identified on and within 120 m of the Transmission Line Project location, including

- seasonal concentration areas (winter deer yards/moose late winter habitat, waterfowl stopover and staging areas and waterfowl nesting sites)
- specialized habitat for wildlife (habitat for area-sensitive species, moose aquatic feeding areas, old growth or mature forest stands, woodlands supporting amphibian breeding habitat, wetlands supporting amphibian breeding habitat, mink, otter, marten and fisher denning sites, specialized raptor nesting habitat seeps and springs)
- habitat for species of conservation concern (Northern Long-eared Bat, Red-necked Grebe, Short-eared Owl, Common Nighthawk, Canada Warbler, Bald Eagle and Olive-sided Flycatcher, *Vaccinium ovalifolium*, *Scirpus heterochaetus*, *Carex wiegandii*, *Carex tetanica*, *Carex loliacea* and *Carex haydenii*)
- animal movement corridors associated with watercourses.

3. Conclusions

Therefore, some components of the Project are located within 120 m of a natural feature (i.e., wildlife habitat and wetlands). As per Section 27 of the REA Regulation, an Evaluation of Significance is required to determine if these natural features are significant.

Appendix G
Natural Heritage
Evaluation of Significance
Report Summaries

**Northland Power Inc.
Abitibi Solar Project****Summary****Natural Heritage Evaluation of Significance****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Evaluation of Significance – Natural Heritage Features for the Abitibi Solar Project.

Northland Power Solar Abitibi L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the District of Cochrane, titled the Abitibi Solar Project (hereinafter referred to as the “Project”). The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the “solar panel Project location.” The solar panel Project location is approximately 98 hectares (ha) in size and located on Lots 14 and 15, Concession 8 of the Town of Cochrane on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20-km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 24 of the REA Regulation requires proponents of Class 3 solar projects to undertake an Evaluation of Significance for each natural heritage feature identified in the records review and site investigations reports within 120 m of the Project. These reports identified the need to complete an Evaluation of Significance:

- Solar Panel Project Location
 - ◆ Waterfowl Nesting habitat
 - ◆ Habitat for area-sensitive species
 - ◆ Wetlands supporting amphibian breeding habitat
 - ◆ Habitat for species of conservation concern, including, Common Nighthawk Habitat, Olive-sided Flycatcher Habitat, Canada Warbler Habitat, *Vaccinium ovalifolium* habitat, *Carex wiegandii* habitat, *Carex haydenii* habitat
 - ◆ Animal movement corridor
- Transmission Line Project Location

- ◆ Generalized Characterized Candidate Significant Wildlife Habitat
- ◆ Seasonal Concentration Areas including, Winter deer yards/moose late winter habitat, Waterfowl stopover and staging areas and Waterfowl nesting sites
- ◆ Specialized Wildlife Habitats including Area-sensitive woodland/shrubland/grassland habitats, Moose aquatic feeding areas, Old growth or mature forest stands, Woodlands supporting amphibian breeding habitat, Wetlands supporting amphibian breeding habitat, Mink, otter, marten and fisher denning sites, Specialized raptor nesting habitat, Seeps and springs
- ◆ Habitat for Species of Conservation Concern including Northern Long-eared Bat, Red-necked Grebe, Short-eared Owl, Common Nighthawk, Canada Warbler, Bald Eagle, Olive-Sided Flycatcher, *Vaccinium ovalifolium*, *Scirpus heterochaetus*, *Carex wiegandii*, *Carex tetanica*, *Carex loliacea* and *Carex haydenii*
- ◆ Animal Movement Corridors associated with several waterbodies within 120 m of the Project location.

2. Results

2.1 Solar Panel Project Location

2.1.1 Seasonal Concentration Areas

Waterfowl Nesting Habitat

Waterfowl nesting habitat identified within 120 m of the Solar Panel Project location during the site investigations is considered to be “Generalized Candidate Significant Wildlife Habitat” and will be carried forward to the Environmental Impact Study.

2.1.2 Specialized Wildlife Habitat

Wetlands Supporting Amphibian Breeding Habitat

The criteria for provision of significant wildlife habitat, degree of permanence, species diversity, size, presence of shrubs and adjacent forest habitat, have been met; this feature is determined to be a significant wetland supporting amphibian breeding habitat.

Habitat for Area-Sensitive Shrubland Species

This habitat is not considered to be significant habitat for area-sensitive species as of the birds detected, none are considered to be area-sensitive shrubland species, and further comparison to the criteria is not required.

Habitat for Area-Sensitive Woodland Species

The woodland in the central portion of the Project location did not meet either the criteria for size or interior forest; this habitat is not considered to be significant.

The woodlands on and within 120 m of the southern portion of the Project location, are not considered to be significant wildlife habitat.

2.1.3 Habitat for Species of Conservation Concern

Canada Warbler

Area searches of woodland habitats did not result in any observations of Canada Warbler. As a result, it is determined that they are not present on or within 120 m of the Project location.

Olive-sided Flycatcher

Area searches of shrubland and woodland habitats did not result in any observations of Olive-sided Flycatcher. As a result, it is determined that they are not present on or within 120 m of the Project location.

Common Nighthawk

Evening bird surveys were completed in conjunction with the second site investigation for wetlands supporting amphibian breeding habitat. No Common Nighthawk were recorded during the surveys on or within 120 m of the Project location.

Carex haydenii

This species was not detected during vegetation surveys of suitable habitats on and within 120 m of the Project location. Details of vegetation surveys have been previously identified in the Natural Heritage Site Investigations Report (Hatch, 2012b).

Carex wiegandii

This species was not detected during vegetation surveys of suitable habitats on and within 120 m of the Project location. Details of vegetation surveys have been previously identified in the Natural Heritage Site Investigations Report (Hatch, 2012b).

Vaccinium ovalifolium

This species was not detected during vegetation surveys of suitable habitats on and within 120 m of the Project location. Details of vegetation surveys have been previously identified in the Natural Heritage Site Investigations Report (Hatch, 2012b).

Animal Movement Corridors

Significant animal movement corridors were determined to be present in the creek and associated riparian habitats on and within 120 m.

2.2 Transmission Line Project Location

The following will be treated as Generalized brought forward to the Environmental Impact Study:

- Seasonal Concentration Areas
 - ◆ Winter deer yards/moose late winter habitat
 - ◆ Waterfowl stopover and staging areas
 - ◆ Waterfowl nesting sites
- Specialized Wildlife Habitats
 - ◆ Area-sensitive woodland/shrubland/grassland habitats
 - ◆ Moose aquatic feeding areas
 - ◆ Old growth or mature forest stands
 - ◆ Woodlands supporting amphibian breeding habitat

- ◆ Wetlands supporting amphibian breeding habitat
- ◆ Mink, otter, marten and fisher denning sites
- ◆ Specialized raptor nesting habitat
- ◆ Seeps and springs.
- Habitat for Species of Conservation Concern including, Northern Long-eared Bat, Red-necked Grebe, Short-eared Owl, Common Nighthawk, Canada Warbler, Bald Eagle, Olive-Sided Flycatcher, *Vaccinium ovalifolium*, *Scirpus heterochaetus*, *Carex wiegandii*, *Carex tetanica*, *Carex loliacea* and *Carex haydenii*
- Animal Movement Corridors associated with several waterbodies within 120 m of the Project location.

2.3 Wetlands

The wetland community on the Solar Panel Project location is a provincially significant wetland. There are no wetlands identified on the Transmission Line Project Location; however, there are a number of wetlands identified within 120 m of this Project location. These wetlands have been identified to be associated with 10 wetland complexes. Two of these wetland complexes have been previously assessed as a provincially significant wetland. The eight remaining wetland complexes are assumed to be provincially significant wetlands.

3. Conclusions

Table 3.1 summarizes the results of the evaluation of significance report.

Therefore, of the natural heritage features evaluated, the wildlife habitat features and wetlands will require an Environmental Impact Study as per Section 38 of the REA Regulation.

Table 3.1 Significant Natural Features on and Within 120 m of the Project Location

Natural Feature		Project Location	Adjacent Lands (within 120 m)
<i>Solar Panel Project Location</i>			
SIGNIFICANT	Wildlife Habitat	Yes	Yes
	Wetland	Yes	Yes
PROVINCIALY SIGNIFICANT	Earth Science ANSI	No	No
	Life Science ANSI	No	No
<i>Transmission Line Project Location</i>			
SIGNIFICANT	Wildlife Habitat	No	Yes (generalized candidate significant wildlife habitat)
	Wetland	No	Yes (2 evaluated, 8 assumed provincially significant)
PROVINCIALY SIGNIFICANT	Earth Science ANSI	No	No
	Life Science ANSI	No	No

**Northland Power Inc.
Empire Solar Project****Summary****Natural Heritage Evaluation of Significance****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Evaluation of Significance – Natural Heritage Features for the Empire Solar Project.

Northland Power Solar Empire L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the Town of Cochrane. This Project, known as the Empire Solar Project, is hereafter referred to as the “Project.” The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the “solar panel Project location”. The solar panel Project location is approximately 122 hectares (ha) in size and located on Lots 17 and 18, Concession 7 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 7.

The second part of the Project is the approximately 20 km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 24 of the REA Regulation requires proponents of Class 3 solar projects to undertake an Evaluation of Significance for each natural heritage feature identified in the records review and site investigations reports within 120 m of the Project. These reports identified the need to complete an Evaluation of Significance:

- Solar Panel Project Location
 - ◆ Habitat for area-sensitive species
 - ◆ Wetlands supporting amphibian breeding habitat
 - ◆ Habitat for species of conservation concern, including Common Nighthawk Habitat, Olive-sided Flycatcher Habitat, *Vaccinium ovalifolium* habitat, *Carex wiegandii* habitat, *Carex haydenii* habitat, *Scirpus heterochaetus* habitat
- Transmission Line Project Location
 - ◆ Generalized Characterized Candidate Significant Wildlife Habitat
 - Seasonal Concentration Areas including Winter deer yards/moose late winter habitat, Waterfowl stopover and staging areas, Waterfowl nesting sites,

- ◆ Specialized Wildlife Habitats including Area-sensitive woodland/shrubland/grassland habitats, Moose aquatic feeding areas, Old growth or mature forest stands, Woodlands supporting amphibian breeding habitat, Wetlands supporting amphibian breeding habitat, Mink, otter, marten and fisher denning sites, Specialized raptor nesting habitat and Seeps and springs
 - Habitat for Species of Conservation Concern including, Northern Long-eared Bat, Red-necked Grebe, Short-eared Owl, Common Nighthawk, Canada Warbler, Bald Eagle, Olive-Sided Flycatcher, *Vaccinium ovalifolium*, *Scirpus heterochaetus*, *Carex wiegandii*, *Carex tetanica*, *Carex loliacea* and *Carex haydenii*
- ◆ Animal Movement Corridors associated with several waterbodies within 120 m of the Project location.

2. Results

2.1 Solar Panel Project Location

2.1.1 *Specialized Wildlife Habitat*

Wetlands Supporting Amphibian Breeding Habitat

The only criteria that was met was presence of shrubs and logs at the edge of the pond; this feature is determined to not be a significant wetland supporting amphibian breeding habitat.

Habitat for Area-Sensitive Shrubland Species

This habitat is not considered to be significant habitat for area-sensitive species as of the birds detected, none are considered to be area-sensitive shrubland species, and further comparison to the criteria is not required.

2.1.2 *Habitat for Species of Conservation Concern*

Canada Warbler

Area searches of woodland habitats, did not result in any observations of Canada Warbler. As a result, it is determined that they are not present on or within 120 m of the Project location.

Olive-sided Flycatcher

Area searches of suitable habitats on the Project location did not result in any observations of Olive-sided Flycatcher. As a result, it is determined that they are not present on or within 120 m of the Project location.

Common Nighthawk

Evening bird surveys were completed in conjunction with the second site investigation for wetlands supporting amphibian breeding habitat. No Common Nighthawk were recorded during the surveys on or within 120 m of the Project location.

Carex haydenii

This species was not detected during vegetation surveys of suitable habitats on and within 120 m of the Project location. Details of vegetation surveys have been previously identified in the Natural Heritage Site Investigations Report.

Carex wiegandii

This species was not detected during vegetation surveys of suitable habitats on and within 120 m of the Project location. Details of vegetation surveys have been previously identified in the Natural Heritage Site Investigations Report.

Scirpus Heterochaetus

This species was not detected during vegetation surveys of suitable habitats on and within 120 m of the Project location. Details of vegetation surveys have been previously identified in the Natural Heritage Site Investigations Report.

Vaccinium ovalifolium

This species was not detected during vegetation surveys of suitable habitats on and within 120 m of the Project location. Details of vegetation surveys have been previously identified in the Natural Heritage Site Investigations Report.

Animal Movement Corridors

Significant animal movement corridors were determined to be present in the creek and associated riparian habitats on and within 120 m.

2.2 Transmission Line Project Location

The following generalized candidate significant wildlife habitats will be brought forward to the Environmental Impact Study:

- Seasonal Concentration Areas
 - ◆ Winter deer yards/moose late winter habitat
 - ◆ Waterfowl stopover and staging areas
 - ◆ Waterfowl nesting sites
- Specialized Wildlife Habitats
 - ◆ Area-sensitive woodland/shrubland/grassland habitats
 - ◆ Moose aquatic feeding areas
 - ◆ Old growth or mature forest stands
 - ◆ Woodlands supporting amphibian breeding habitat
 - ◆ Wetlands supporting amphibian breeding habitat
 - ◆ Mink, otter, marten and fisher denning sites
 - ◆ Specialized raptor nesting habitat
 - ◆ Seeps and springs
- Habitat for Species of Conservation Concern
 - ◆ Northern Long-eared Bat
 - ◆ Red-necked Grebe
 - ◆ Short-eared Owl

- ◆ Common Nighthawk
- ◆ Canada Warbler
- ◆ Bald Eagle
- ◆ Olive-Sided Flycatcher
- ◆ *Vaccinium ovalifolium*
- ◆ *Scirpus heterochaetus*
- ◆ *Carex wiegandii*
- ◆ *Carex tetanica*
- ◆ *Carex loliacea*
- ◆ *Carex haydenii*
- Animal Movement Corridors associated with several waterbodies within 120 m of the Project location.

2.3 Wetlands

The wetland community on the Solar Panel Project location is a provincially significant wetland. There are no wetlands identified on the Transmission Line Project Location; however, there are a number of wetlands identified within 120 m of this Project location. These wetlands have been identified to be associated with 10 wetland complexes. Two of these wetland complexes have been previously assessed as a provincially significant wetland. The eight remaining wetland complexes are assumed to be provincially significant wetlands.

3. Conclusions

Table 3.1 summarizes the results of the evaluation of significance report.

Therefore, of the natural heritage features evaluated, the wildlife habitat features and wetlands will require an Environmental Impact Study as per Section 38 of the REA Regulation.

Table 3.1 Significant Natural Features on and within 120 m of the Project Location

Natural Feature	Project Location	Adjacent Lands (within 120 m)
<i>Solar Panel Project Location</i>		
SIGNIFICANT	Wildlife Habitat	No
PROVINCIALY SIGNIFICANT	Wetland	Yes
	Earth Science ANSI	No
	Life Science ANSI	No
<i>Transmission Line Project Location</i>		
SIGNIFICANT	Wildlife Habitat	Yes (generalized candidate significant wildlife habitat)
PROVINCIALY SIGNIFICANT	Wetland	Yes (2 evaluated, 8 assumed provincially significant)
	Earth Science ANSI	No
	Life Science ANSI	No

**Northland Power Inc.
Martin's Meadows Solar Project
Summary**

Natural Heritage Evaluation of Significance

1. Introduction

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Evaluation of Significance – Natural Heritage Features for the Martin's Meadows Solar Project.

Northland Power Solar Martin's Meadows L.P. (hereinafter referred to as "Northland") is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic facility in the Town of Cochrane. This Project, known as the Martin's Meadows Solar Project, is hereafter referred to as "Martin's Meadows" or the "Project". The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the "solar panel Project location". The solar panel Project location is approximately 82 hectares (ha) in size and located on Lot 16, Concession 8 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20 km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 24 of the REA Regulation requires proponents of Class 3 solar projects to undertake an Evaluation of Significance for each natural heritage feature identified in the records review and site investigations reports within 120 m of the Project. These reports identified the need to complete an Evaluation of Significance:

- Solar Panel Project Location
 - ◆ Wetlands
 - ◆ Waterfowl Nesting habitat
 - ◆ Habitat for area-sensitive species
 - ◆ Wetlands supporting amphibian breeding habitat
 - ◆ Habitat for species of conservation concern, including, Common Nighthawk Habitat, Olive-sided Flycatcher Habitat, *Vaccinium ovalifolium* habitat, *Carex wiegandii* habitat, *Scirpus heterochaetus* habitat and *Carex haydenii* habitat
 - ◆ Animal movement corridor

- Transmission Line Project Location
 - ◆ Generalized Characterized Candidate Significant Wildlife Habitat
 - ◆ Seasonal Concentration Areas including, Winter deer yards/moose late winter habitat, Waterfowl stopover and staging areas and Waterfowl nesting sites
 - ◆ Specialized Wildlife Habitats including Area-sensitive woodland/shrubland/grassland habitats, Moose aquatic feeding areas, Old growth or mature forest stands, Woodlands supporting amphibian breeding habitat, Wetlands supporting amphibian breeding habitat, Mink, otter, marten and fisher denning sites, Specialized raptor nesting habitat, Seeps and springs
 - ◆ Habitat for Species of Conservation Concern including Northern Long-eared Bat, Red-necked Grebe, Short-eared Owl, Common Nighthawk, Canada Warbler, Bald Eagle, Olive-Sided Flycatcher, *Vaccinium ovalifolium*, *Scirpus heterochaetus*, *Carex wiegandii*, *Carex tetanica*, *Carex loliacea* and *Carex haydenii*
 - ◆ Animal Movement Corridors associated with several waterbodies within 120 m of the Project location

2. Results

2.1 Solar Panel Project Location

2.1.1 Seasonal Concentration Areas

Waterfowl Nesting Habitat

As there was no waterfowl nesting confirmed on or within 120 m of the Project location, consideration of further criteria is not required, and this feature is determined to not be a significant waterfowl nesting area.

2.1.2 Specialized Wildlife Habitat

Wetlands Supporting Amphibian Breeding Habitat

The criteria for provision of significant wildlife habitat, degree of permanence, species diversity, size, presence of shrubs and adjacent forest habitat have been met; this feature is determined to be a significant wetland supporting amphibian breeding habitat.

Habitat for Area-Sensitive Shrubland Species

This habitat is not considered to be significant habitat for area-sensitive species as of the birds detected, none are considered to be area-sensitive shrubland species, and further comparison to the criteria is not required.

Habitat for Area-Sensitive Woodland Species

Regarding the woodlands on and within 120 m of the Munroe Creek crossing, though several of the criteria have been met, as American Redstart are an abundant species both within the region and the province, and since breeding habitat for American Redstart is also abundantly available across the province, areas of habitat on and within 120 m of the Project location are not considered to be significant wildlife habitat

2.1.3 *Habitat for Species of Conservation Concern*

Olive-sided Flycatcher

Area searches of shrubland and woodland habitats did not result in any observations of Olive-sided Flycatcher. As a result, it is determined that they are not present on or within 120 m of the Project location.

Common Nighthawk

Evening bird surveys were completed in conjunction with the second site investigation for wetlands supporting amphibian breeding habitat. No Common Nighthawk were recorded during the surveys on or within 120 m of the Project location.

Carex haydenii

This species was not detected during vegetation surveys of suitable habitats on and within 120 m of the Project location. Details of vegetation surveys have been previously identified in the Natural Heritage Site Investigations Report.

Carex wiegandii

This species was not detected during vegetation surveys of suitable habitats on and within 120 m of the Project location. Details of vegetation surveys have been previously identified in the Natural Heritage Site Investigations Report.

Vaccinium ovalifolium

This species was not detected during vegetation surveys of suitable habitats on and within 120 m of the Project location. Details of vegetation surveys have been previously identified in the Natural Heritage Site Investigations Report.

Scirpus heterochaetus

This species was not detected during vegetation surveys of suitable habitats on and within 120 m of the Project location. Details of vegetation surveys have been previously identified in the Natural Heritage Site Investigations Report.

Animal Movement Corridors

A significant animal movement was identified in association with the creek and the associated riparian habitat on and within 120 m of the Project location

2.2 **Transmission Line Project Location**

The following generalized candidate significant wildlife habitats will be brought forward to the Environmental Impact Study:

- Seasonal Concentration Areas
 - ◆ Winter deer yards/moose late winter habitat
 - ◆ Waterfowl stopover and staging areas
 - ◆ Waterfowl nesting sites
- Specialized Wildlife Habitats
 - ◆ Area-sensitive woodland/shrubland/grassland habitats
 - ◆ Moose aquatic feeding areas
 - ◆ Old growth or mature forest stands

- ◆ Woodlands supporting amphibian breeding habitat
- ◆ Wetlands supporting amphibian breeding habitat
- ◆ Mink, otter, marten and fisher denning sites
- ◆ Specialized raptor nesting habitat
- ◆ Seeps and springs
- Habitat for Species of Conservation Concern including Northern Long-eared Bat, Red-necked Grebe, Short-eared Owl, Common Nighthawk, Canada Warbler, Bald Eagle, Olive-Sided Flycatcher, *Vaccinium ovalifolium*, *Scirpus heterochaetus*, *Carex wiegandii*, *Carex tetanica*, *Carex loliacea* and *Carex haydenii*
- Animal Movement Corridors associated with several waterbodies within 120 m of the Project location.

2.3 Wetlands

The wetland community on the Solar Panel Project location are considered provincially significant wetlands. There are no wetlands identified on the Transmission Line Project Location; however, there are a number of wetlands identified within 120 m of this Project location. These wetlands have been identified to be associated with 10 wetland complexes. Two of these wetland complexes have been previously assessed as a provincially significant wetland. The eight remaining wetland complexes are assumed to be provincially significant wetlands.

3. Conclusions

Table 3.1 summarizes the results of the evaluation of significance report.

Therefore, of the natural heritage features evaluated, the wildlife habitat features and wetlands will require an Environmental Impact Study as per Section 38 of the REA Regulation.

Table 3.1 Significant Natural Features on and within 120 m of the Project Location

Natural Feature		Project Location	Adjacent Lands (within 120 m)
<i>Solar Panel Project Location</i>			
SIGNIFICANT	Wildlife Habitat	Yes	Yes
	Wetland	Yes	Yes
PROVINCIALY SIGNIFICANT	Earth Science ANSI	No	No
	Life Science ANSI	No	No
<i>Transmission Line Project Location</i>			
SIGNIFICANT	Wildlife Habitat	No	Yes (generalized candidate significant wildlife habitat)
	Wetland	No	Yes (2 evaluated, 8 assumed provincially significant)
PROVINCIALY SIGNIFICANT	Earth Science ANSI	No	No
	Life Science ANSI	No	No

Appendix H
Natural Heritage
Environmental Impact
Study Summaries

**Northland Power Inc.
Abitibi Solar Project****Summary****Natural Heritage Environmental Impact Study****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Environmental Impact Study – Natural Heritage Features for the Abitibi Solar Project.

Northland Power Solar Abitibi L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the District of Cochrane, titled the Abitibi Solar Project (hereinafter referred to as the “Project”). The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the “solar panel Project location.” The solar panel Project location is approximately 98 hectares (ha) in size and located on Lots 14 and 15, Concession 8 of the Town of Cochrane on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20-km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 38 of the REA Regulation requires proponents of Class 3 solar projects to complete an Environmental Impact Study (EIS) for all significant natural heritage features determined to be within a specified setback in order to obtain a REA. The EIS is required in order to determine (i) any potential negative environmental effects on the natural features (ii) identify mitigation measures (iii) describe how the environmental effects monitoring plan in the Design and Operations Report addresses any negative environmental effects and (iv) describe how the Construction Plan Report addresses any negative environmental effects.

The natural heritage features that were classified as significant are significant wildlife habitat that included

- wetlands supporting amphibian breeding habitat/ waterfowl nesting habitat
- wetlands on and within 120 m of the solar panel Project location
- generalized candidate significant wildlife habitat/wetlands within 120 m of the transmission line Project location.

2. Results

The results of the EIS on the significant natural features are summarized in Table 2.1.

Table 2.1 Summary of Potential Negative Environmental Effects and Proposed Mitigation

Negative Effect	Mitigation Strategy
Construction Phase	
Clearing within wooded areas.	Demarcation of work areas. Restrictions on entry into natural areas beyond work areas.
Disruption of wildlife breeding within natural features	Vegetation removal on the solar panel project location/ construction of the transmission line to be timed outside of the bird breeding period (May through July), wherever possible.
Dust generation and off-site transport	Standard construction site best management practices to prevent fugitive dust.
Operation Phase	
Decommissioning Phase	
Disruption of wildlife breeding within natural features	Decommissioning to be timed outside of the bird breeding period (May through July), wherever possible.
Dust generation and off-site transport	Standard site best management practices to prevent fugitive dust.

Table 4.1 in the EIS summarizes the proposed monitoring plan.

As discussed in the Design and Operations Report, environmental effects monitoring is proposed with respect to any negative environmental effects that may result from engaging in the Project. The monitoring plan in the Design and Operations Report identifies: performance objectives with respect to the negative environmental effects; mitigation measures to assist in achieving the performance objectives; and, a program for monitoring negative environmental effects for the duration of the time the Project is engaged in, including a contingency plan to be implemented if any mitigation measures fail.

In addition, the Construction Plan Report for the Project details the construction and installation activities, location and timing of construction and installation activities, any negative environmental effects that result from construction activities within 300 m of the Project and mitigation measures for the identified negative environmental effects.

3. Conclusions

The EIS has been prepared to identify potential negative environmental effects that all phases of the Project may have on the significant natural feature. Mitigation measures have been proposed to prevent these effects from occurring or minimize the magnitude, extent, duration and frequency in the event that they do occur to an acceptable level.

**Northland Power Inc.
Empire Solar Project****Summary****Natural Heritage Environmental Impact Study****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Environmental Impact Study - Natural Heritage Features for the Empire Solar Project.

Northland Power Solar Empire L.P. (hereinafter referred to as "Northland") is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the Town of Cochrane. This Project, known as the Empire Solar Project, is hereafter referred to as the "Project." The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the "solar panel Project location" The solar panel Project location approximately 122 hectares (ha) in size and located on Lots 17 and 18, Concession 7 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 7.

The second part of the Project is the approximately 20 km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 38 of the REA Regulation requires proponents of Class 3 solar projects to complete an Environmental Impact Study (EIS) for all significant natural heritage features determined to be within a specified setback in order to obtain a REA. The EIS is required in order to determine (i) any potential negative environmental effects on the natural features (ii) identify mitigation measures (iii) describe how the environmental effects monitoring plan in the Design and Operations Report addresses any negative environmental effects and (iv) describe how the Construction Plan Report addresses any negative environmental effects.

The natural heritage features that were classified as significant are significant wildlife habitat that included

- Solar panel Project location
 - ◆ Wetlands
- Transmission line Project location
 - ◆ Wetlands
 - ◆ Generalized Characterized Candidate Significant Wildlife Habitat

- ♦ Animal Movement Corridors associated with several waterbodies within 120 m of the Project location.

2. Results

The results of the EIS on the significant natural features are summarized in Table 2.1.

Table 2.1 Summary of Potential Negative Environmental Effects and Proposed Mitigation

Negative Effect	Mitigation Strategy
Construction Phase	
Clearing within naturally vegetated areas.	Demarcation of work areas. Restrictions on entry into natural areas beyond work areas.
Disruption of wildlife breeding within natural features	Vegetation removal on the solar panel project location/ construction of the transmission line to be timed outside of the bird breeding period (May through July), wherever possible.
Dust generation and off-site transport	Standard construction site best management practices to prevent fugitive dust.
Operation Phase	
Decommissioning Phase	
Disruption of wildlife breeding within natural features	Decommissioning to be timed outside of the bird breeding period (May through July), wherever possible.
Dust generation and off-site transport	Standard site best management practices to prevent fugitive dust.

Table 5.1 in the EIS summarizes the proposed monitoring plan.

As discussed in the Design and Operations Report, environmental effects monitoring is proposed with respect to any negative environmental effects that may result from engaging in the Project. The monitoring plan in the Design and Operations Report identifies: performance objectives with respect to the negative environmental effects; mitigation measures to assist in achieving the performance objectives; and, a program for monitoring negative environmental effects for the duration of the time the Project is engaged in, including a contingency plan to be implemented if any mitigation measures fail.

In addition, the Construction Plan Report for the Project details the construction and installation activities, location and timing of construction and installation activities, any negative environmental effects that result from construction activities within 300 m of the Project and mitigation measures for the identified negative environmental effects.

3. Conclusions

The EIS has been prepared to identify potential negative environmental effects that all phases of the Project may have on the significant natural feature. Mitigation measures have been proposed to prevent these effects from occurring or minimize the magnitude, extent, duration and frequency in the event that they do occur to an acceptable level.

Northland Power Inc.
Martin's Meadows Solar Project
Summary

Natural Heritage Environmental Impact Study

1. Introduction

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Environmental Impact Study - Natural Heritage Features for the Martin's Meadows Solar Project.

Northland Power Solar Martin's Meadows L.P. (hereinafter referred to as "Northland") is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic facility in the Town of Cochrane. This Project, known as the Martin's Meadows Solar Project, is hereafter referred to as "Martin's Meadows" or the "Project". The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the "solar panel Project location". The solar panel Project location is approximately 82 hectares (ha) in size and located on Lot 16, Concession 8 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20-km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON. The interconnection point will be at the intersection of Highway 668 and Concessions 8 and 9, approximately 21 km west of the Project location. This portion of the project is referred to as the transmission line Project location.

Section 38 of the REA Regulation requires proponents of Class 3 solar projects to complete an Environmental Impact Study (EIS) for all significant natural heritage features determined to be within a specified setback in order to obtain a REA. The EIS is required in order to determine (i) any potential negative environmental effects on the natural features (ii) identify mitigation measures (iii) describe how the environmental effects monitoring plan in the Design and Operations Report addresses any negative environmental effects and (iv) describe how the Construction Plan Report addresses any negative environmental effects.

The natural heritage features that were classified as significant are wetlands and significant wildlife habitat that included

- Solar panel Project location
 - ◆ Animal movement corridor associated with the creek and riparian habitat
 - ◆ Wetlands supporting amphibian breeding habitat around Munroe Creek
- Generalized candidate significant wildlife habitat/wetlands within 120 m of the transmission line Project location.

2. Results

The results of the EIS on the significant natural features are summarized in Table 2.1.

Table 2.1 Summary of Potential Negative Environmental Effects and Proposed Mitigation

Negative Effect	Mitigation Strategy
Construction Phase	
Clearing within wooded areas.	Demarcation of work areas. Restrictions on entry into natural areas beyond work areas.
Construction of access road crossing and connection line across wildlife habitats and wetlands associated with Munroe Creek	Demarcation of work areas. Restrictions on entry into natural areas beyond work areas. Guidelines for installation of lines and access roads to be followed.
Disruption of wildlife breeding within natural features	Vegetation removal on the solar panel project location/ construction of the transmission line to be timed outside of the bird breeding period (May through July), wherever possible.
Dust generation and off-site transport	Standard construction site best management practices to prevent fugitive dust.
Operation Phase	
Decommissioning Phase	
Disruption of wildlife breeding within natural features	Vegetation removal on the solar panel project location/ construction of the transmission line to be timed outside of the bird breeding period (May through July), wherever possible.
Decommissioning of access road crossing and connection line across wildlife habitats and wetlands associated with Munroe Creek	Demarcation of work areas. Restrictions on entry into natural areas beyond work areas. Guidelines for installation of lines and access roads to be followed.
Dust generation and off-site transport	Standard site best management practices to prevent fugitive dust.

Table 5.1 in the EIS summarizes the proposed monitoring plan.

As discussed in the Design and Operations Report, environmental effects monitoring is proposed with respect to any negative environmental effects that may result from engaging in the Project. The monitoring plan in the Design and Operations Report identifies: performance objectives with respect to the negative environmental effects; mitigation measures to assist in achieving the performance objectives; and, a program for monitoring negative environmental effects for the duration of the time the Project is engaged in, including a contingency plan to be implemented if any mitigation measures fail.

In addition, the Construction Plan Report for the Project details the construction and installation activities, location and timing of construction and installation activities, any negative environmental effects that result from construction activities within 300 m of the Project and mitigation measures for the identified negative environmental effects.

3. Conclusions

The EIS has been prepared to identify potential negative environmental effects that all phases of the Project may have on the significant natural feature. Mitigation measures have been proposed to prevent these effects from occurring or minimize the magnitude, extent, duration and frequency in the event that they do occur to an acceptable level.

Appendix I
Water Body
Records Review Report Summaries

**Northland Power Inc.
Abitibi Solar Project****Summary****Water Body Records Review Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Ontario Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Water Body Records Review Report for the Abitibi Solar Project.

Northland Power Solar Abitibi L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the District of Cochrane, titled the Abitibi Solar Project (hereinafter referred to as the “Project”). The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the “solar panel Project location.” The solar panel Project location is approximately 98 hectares (ha) in size and located on Lots 14 and 15, Concession 8 of the Town of Cochrane on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20-km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 30 of the REA Regulation requires proponents of Class 3 solar projects to undertake a Water Body Records Review. The focus of the assessment was on identifying whether or not the Project was located within or adjacent to any of the specified water features (e.g., within 120 m of the average annual high water mark of a permanent or intermittent stream). Records were searched from the Ministry of Natural Resources (MNR), Ontario Ministry of Agriculture, Food and Rural Affairs, federal government, Town of Cochrane, and other relevant sources.

2. Results

Key water body features and points of interest identified during the records review include the following:

- The MNR natural features layer from the LIO dataset indicates that a portion Munroe Creek passes within 120 m of the western boundary of the solar Panel Project location. Munroe Creek flows in a south-north direction, and originates approximately 900 m southwest of the Project Location at Lauzon Lake.

- The MNR mapping shows that Munroe Creek discharges into the Abitibi River, which is located several kilometers north of the Project Location.
- LIO mapping shows a total of 24 waterbodies crossing the proposed transmission line options, including a crossing of the Frederickhouse River, which is a tributary of the Albany River in the Moose River Basin. There are 10 other waterbodies shown in the figures that do not cross the proposed transmission line routes, but are located within 120 m of the transmission line corridor, including Lower Deception Lake.

3. Conclusions

Table 3.1 summarizes the results of the records review.

Table 3.1 Summary of Records Review Determinations

Determination to be Made	Yes/No	Description
Is the Project in a water body?	No	No water body features were identified on the Project Location.
Is the Project within 120 m of the average annual high water mark of a lake, other than a lake trout lake that is at or above development capacity?	Yes	No lakes were identified within 120 m of the solar panel Project location. The proposed transmission line will come within 120 m of the average annual high water mark of Lower Deception Lake.
Is the Project within 300 m of the average annual high water mark of a lake trout lake that is at or above development capacity?	No	No lake trout lakes were identified within 300 m of the solar panel or transmission line Project locations.
Is the Project within 120 m of the average annual high water mark of a permanent or intermittent stream?	Yes	The average annual high water mark of Munroe Creek is located within 120 m of the solar Panel Project location. A surface water drainage feature visible on aerial photography may also be a permanent or intermittent stream, and would be within 120 m of the solar Panel Project location. There are 34 watercourses located within 120 m of the transmission line Project location.
Is the Project within 120 m of a seepage area?	No	No seepage areas were identified on or within 120 m of the Project Location.

As per Section 31 of the REA Regulation, a site investigation will be completed to (i) confirm the features identified during this records review, (ii) identify if any corrections to the information presented herein are required, (iii) determine whether any additional waterbodies exist in the Project area, (iv) confirm the boundaries of any water feature within 120 m of the Project and (v) determine the distance from the Project to the water boundary.

**Northland Power Inc.
Empire Solar Project****Summary****Water Body Records Review Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Ontario Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Water Body Records Review Report for the Empire Solar Project.

Northland Power Solar Empire L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the Town of Cochrane. This Project, known as the Empire Solar Project, is hereafter referred to as the “Project.” The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the “solar panel Project location”. The solar panel Project location is approximately 122 hectares (ha) in size and located on Lots 17 and 18, Concession 7 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 7.

The second part of the Project is the approximately 20 km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 30 of the REA Regulation requires proponents of Class 3 solar projects to undertake a Water Body Records Review. The focus of the assessment was on identifying whether or not the Project was located within or adjacent to any of the specified water features (e.g., within 120 m of the average annual high water mark of a permanent or intermittent stream). Records were searched from the Ministry of Natural Resources (MNR), Ontario Ministry of Agriculture, Food and Rural Affairs, federal government, Town of Cochrane, and other relevant sources.

2. Results

Key water body features and points of interest identified during the records review include the following:

- The MNR natural features layer from the LIO indicates the presence of a tributary of Munroe Creek within 120 m of the northeast corner of the Project Location. An unnamed watercourse is present within the southwest corner of the Project Location. Lauzon Lake is approximately 250 m east of the Project Location

- LIO mapping shows a total of 24 waterbodies crossing the proposed transmission line options, including a crossing of the Frederickhouse River, which is a tributary of the Albany River in the Moose River Basin. There are 10 other waterbodies shown in the figures that do not cross the proposed transmission line routes, but are located within 120 m of the transmission line corridor, including Lower Deception Lake.

3. Conclusions

Table 3.1 summarizes the results of the records review.

Table 3.1 Summary of Records Review Determinations

Determination to be Made	Yes/No	Description
Is the Project in a water body?	Yes	There are no waterbodies on the solar Panel Project location, but the transmission line Project location will cross approximately 24 watercourses.
Is the Project within 120 m of the average annual high water mark of a lake, other than a lake trout lake that is at or above development capacity?	Yes	No lakes were identified within 120 m of the solar panel Project location. Lower Deception Lake is located along Transmission Line Option A.
Is the Project within 300 m of the average annual high water mark of a lake trout lake that is at or above development capacity?	No	No lake trout lakes were identified within 300 m of the solar panel or transmission line Project locations.
Is the Project within 120 m of the average annual high water mark of a permanent or intermittent stream?	Yes	Two waterbodies were identified on and within 120 m of the solar panel Project Location: Munroe Creek on the northeast corner and an unnamed watercourse on the southwest corner. There are 34 watercourses located within 120 m of the transmission line Project location.
Is the Project within 120 m of a seepage area?	No	No seepage areas were identified on or within 120 m of the Project Location.

As per Section 31 of the REA Regulation, a site investigation will be completed to (i) confirm the features identified during this records review, (ii) identify if any corrections to the information presented herein are required, (iii) determine whether any additional waterbodies exist in the Project area, (iv) confirm the boundaries of any water feature within 120 m of the Project and (v) determine the distance from the Project to the water boundary.

**Northland Power Inc.
Martin's Meadows Solar Project
Summary**

Water Body Records Review Report

1. Introduction

As per Section 17 of the Renewable Energy Approvals (REA) Ontario Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Water Body Records Review Report for the Martin's Meadows Solar Project.

Northland Power Solar Martin's Meadows L.P. (hereinafter referred to as "Northland") is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic facility in the Town of Cochrane. This Project, known as the Martin's Meadows Solar Project, is hereafter referred to as "Martin's Meadows" or the "Project". The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the "solar panel Project location". The solar panel Project location is approximately 82 hectares (ha) in size and located on Lot 16, Concession 8 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20-km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 30 of the REA Regulation requires proponents of Class 3 solar projects to undertake a Water Body Records Review. The focus of the assessment was on identifying whether or not the Project was located within or adjacent to any of the specified water features (e.g., within 120 m of the average annual high water mark of a permanent or intermittent stream). Records were searched from the Ministry of Natural Resources (MNR), Ontario Ministry of Agriculture, Food and Rural Affairs, federal government, Town of Cochrane, and other relevant sources.

2. Results

Key water body features and points of interest identified during the records review include the following:

- The MNR natural features layer from the LIO indicates the presence of Munroe Creek within 120 m to the east of the solar panel Project Location. Munroe Creek flows from Lauzon Lake which is located approximately 900 m south of the Project Location. Munroe Creek would be crossed by the access road and connection line to the adjoining facility.

- A tributary of Munroe Creek occurs within 120 m to the west and southwest of the solar panel Project Location.
- LIO mapping shows a total of 24 waterbodies crossing the proposed transmission line options, including a crossing of the Frederickhouse River, which is a tributary of the Albany River in the Moose River Basin. There are 10 other waterbodies shown in the figures that do not cross the proposed transmission line routes, but are located within 120 m of the transmission line corridor, including Lower Deception Lake.

3. Conclusions

Table 3.1 summarizes the results of the records review.

Table 3.1 Summary of Records Review Determinations

Determination to be Made	Yes/No	Description
Is the Project in a water body?	Yes	The proposed access road to the adjoining facility will cross Munroe Creek.
Is the Project within 120 m of the average annual high water mark of a lake, other than a lake trout lake that is at or above development capacity?	Yes	No lakes were identified within 120 m of the Project location. The proposed transmission line will come within 120 m of Lower Deception Lake.
Is the Project within 300 m of the average annual high water mark of a lake trout lake that is at or above development capacity?	No	No lake trout lakes were identified within 300 m of the Project location.
Is the Project within 120 m of the average annual high water mark of a permanent or intermittent stream?	Yes	Two watercourses were identified within 120 m of the Project Location: Munroe Creek to the east and a tributary of Munroe Creek to the west. There are several other drainage features visible on aerial photography of the Project location, but it is unknown if these meet the definition of a water body per the REA Regulation. There are 34 watercourses located within 120 m of the transmission line Project location.
Is the Project within 120 m of a seepage area?	No	No seepage areas were identified on or within 120 m of the Project Location.

As per Section 31 of the REA Regulation, a site investigation will be completed to (i) confirm the features identified during this records review, (ii) identify if any corrections to the information presented herein are required, (iii) determine whether any additional waterbodies exist in the Project area, (iv) confirm the boundaries of any water feature within 120 m of the Project and (v) determine the distance from the Project to the water boundary.

Appendix J
Water Body
Site Investigation
Report Summaries

**Northland Power Inc.
Abitibi Solar Project****Summary****Water Body Site Investigations Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Ontario Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Water Body Site Investigations Report for the Abitibi Solar Project.

Northland Power Solar Abitibi L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the District of Cochrane, titled the Abitibi Solar Project (hereinafter referred to as the “Project”). The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the “solar panel Project location.” The solar panel Project location is approximately 98 hectares (ha) in size and located on Lots 14 and 15, Concession 8 of the Town of Cochrane on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20-km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 31 of the REA Regulation requires proponents of Class 3 solar projects to undertake a water site investigation for the purpose of determining if the information provided in the Water Body Records Review Report is correct and identifies any knowledge gaps, if any additional waterbodies are present on or within 120 m of the Project site, and if the borders and distance of the waterbodies from the Project site are correct. A site visit was completed to obtain this information.

2. Results***Solar Panel Project Location***

Two waterbodies, including Monroe Creek, were identified on and within 120 m of the solar panel Project location.

Monroe Creek

- The Land Information Ontario (LIO) mapping obtained for the Water Body Records Review Report indicates that Munroe Creek originates approximately 800 m southwest of the Project Location at Lauzon Lake and flows north where it eventually discharges into the Abitibi River.

- Munroe Creek is a permanent water body that flows through wetland communities (i.e., narrow-leaved emergent marsh, tall shrub swamp) and woodlands dominated by trembling aspen, black spruce and balsam fir.

Watercourse A

- Watercourse A is both an intermittent and permanent stream that originates in an agricultural field on the north-central portion of the property on which the Project is located.
- The intermittent reach of Watercourse A occurs at its point of origin and continues south for approximately 100 m. This 100 m reach has a channel-width of approximately 3 m, with 1.5-m high banks. The average annual high watermark was determined to be top of bank. No flowing water was present along this stretch of Watercourse A. The channel was found to contain water-favouring wetland meadow species such as cattails, sedges, rushes and grasses.
- As Watercourse A extends in a southern direction near the central portion of the Project Location, it enters a thicket area of dense in-stream and riparian vegetation for approximately 200 m (Figure 1.1). In this area, the watercourse continues to exist as an intermittent stream.
- Watercourse A extends south into dense thicket and woodland as a permanent stream for approximately 300 m. The channel width and average annual high water mark increases to approximately 4 m, up to a maximum of 6 m, along this stretch – with about 0.5-m high banks.

Transmission Line Project Location

- There were 36 unnamed watercourses, the Frederickhouse River and Deception Creek. In addition, the proposed transmission line will pass within 120 m of Lower Deception Lake.

3. Conclusions

Corrections to Water Body Records Review Report are summarized below.

Determination to be Made	Corrections Required? (Yes/No)	Description
Is the Project Location in a water body?	No	No part of the project will be located within a water body.
Is the Project Location within 120 m of the average annual high water mark of a lake, other than a lake trout lake that is at or above development capacity?	No	The site investigation confirmed that there are no lakes on or within 120 m of the solar panel Project Location. The site investigation confirmed that the proposed transmission line will run within 120 m of the average annual high water mark of Lower Deception Lake. There are no corrections required to the <i>Water Body Records Review Report</i> (Hatch Ltd., 2012) with respect to lakes.
Is the Project Location within 300 m of the average annual high water mark of a lake trout lake that is at or above development capacity?	No	No lake trout lakes are situated on or within 300 m of the Project Location. There are no corrections required to the <i>Water Body Records Review Report</i> (Hatch Ltd., 2012) with respect to lake trout lakes.
Is the Project Location within 120 m of the average annual high water mark of a permanent or intermittent stream?	Yes	The records review identified a portion of Munroe Creek within 120 m west of the Project Location. This water body feature was confirmed during the site investigations. Therefore, there are no corrections required with respect to this water body feature.

Determination to be Made	Corrections Required? (Yes/No)	Description
		<p>However, the site investigations did confirm the presence of a permanent/intermittent stream running through the central portion of the solar panel Project location. Therefore, the following corrections are required.</p> <ul style="list-style-type: none"> • The <i>Water Body Records Review Report</i> (Hatch Ltd., 2012) did not identify Watercourse A (i.e., a permanent/intermittent stream) which extends the length of the central portion of the Project Location, and continuing east along the southern boundary and beyond the 120 m setback. • In addition, the proposed transmission line Project location will cross or run within 120 m of approximately 38 waterbodies, which is different than noted in the Records Review.
Is the Project Location within 120 m of a seepage area?	No	The site investigation confirmed that there are no seepage areas on or within 120 m of the Project Location. There are no corrections required to the <i>Water Body Records Review Report</i> (Hatch Ltd., 2012) with respect to seepage areas.

Based on the results of the site investigation and the proposed Project location, some components of the Project will be located between 30 and 120 m of the average annual high water mark of the Monroe Creek, Watercourse A and 38 watercourses regarding the transmission line Project location. Therefore, an EIS will be required to assess the potential effects of the Project and the required mitigation measures to prevent or minimize adverse effects on these waterbodies.

**Northland Power Inc.
Empire Solar Project****Summary****Water Body Site Investigations Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Ontario Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Water Body Site Investigations Report for the Empire Solar Project.

Northland Power Solar Empire L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the Town of Cochrane. This Project, known as the Empire Solar Project, is hereafter referred to as the “Project.” The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the “solar panel Project location” The solar panel Project location approximately 122 hectares (ha) in size and located on Lots 17 and 18, Concession 7 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 7.

The second part of the Project is the approximately 20-km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 31 of the REA Regulation requires proponents of Class 3 solar projects to undertake a water site investigation for the purpose of determining if the information provided in the Water Body Records Review Report is correct and identifies any knowledge gaps, if any additional waterbodies are present on or within 120 m of the Project site, and if the borders and distance of the waterbodies from the Project site are correct. A site visit was completed to obtain this information.

2. Results***Solar Panel Project Location***

Two waterbodies, including an unnamed watercourse and a tributary of Monroe Creek, were identified on and within 120 m of the solar panel Project location.

Unnamed Watercourse

- Unnamed Watercourse originates in the open field approximately 30 m west of the Project location and flows in an easterly direction through the property on which the Project is located.
- Continuing eastward the channel gradually becomes narrower reaching a minimum width of approximately 1 m. Standing water, vegetation and exposed bedrock was present within this portion of the watercourse.

- The proposed development footprint will be located between 30 and 120 m from the Unnamed Watercourse; therefore, an Environmental Impact Study (EIS) will be required.

Tributary of Monroe Creek

- This tributary originates to the north of the solar panel Project location in an agricultural field and drains through a wooded area in the northeast corner of the property on which the Project is located, before draining into Lauzon Lake, approximately 350 m east of the Project location.
- The tributary had a poorly defined channel and was not flowing during the August 2010 site investigation and it was determined to be an intermittent watercourse. The average annual high water mark was determined on the basis of the wetland meadow marsh community surrounding the general watercourse location.
- The development will be located within 30 m of the average annual high water mark of this tributary, and it will be crossed by the connection line to the adjoining facility, an EIS will be required to assess potential effects and mitigation requirements

Transmission Line Project Location

- There were 36 unnamed watercourses, the Frederickhouse River and Deception Creek. In addition, the proposed transmission line will pass within 120 m of Lower Deception Lake.

3. Conclusions

Based on the results of the site investigation and the proposed Project location, some components of the Project will be located between 30 and 120 m of the average annual high water mark of the tributary of Monroe Creek, Unnamed Watercourse and 38 watercourses regarding the transmission line Project location. Therefore, an EIS will be required to assess the potential effects of the Project and the required mitigation measures to prevent or minimize adverse effects on these waterbodies.

**Northland Power Inc.
Martin's Meadows Solar Project
Summary**

Water Body Site Investigations Report

1. Introduction

As per Section 17 of the Renewable Energy Approvals (REA) Ontario Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Water Body Site Investigations Report for the Martin's Meadows Solar Project.

Northland Power Solar Martin's Meadows L.P. (hereinafter referred to as "Northland") is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic facility in the Town of Cochrane. This Project, known as the Martin's Meadows Solar Project, is hereafter referred to as "Martin's Meadows" or the "Project". The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the "solar panel Project location". The solar panel Project location is approximately 82 hectares (ha) in size and located on Lot 16, Concession 8 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20-km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Section 31 of the REA Regulation requires proponents of Class 3 solar projects to undertake a water site investigation for the purpose of determining if the information provided in the Water Body Records Review Report is correct and identifies any knowledge gaps, if any additional waterbodies are present on or within 120 m of the Project site, and if the borders and distance of the waterbodies from the Project site are correct. A site visit was completed to obtain this information.

2. Results

Solar Panel Project Location

Three waterbodies, including Monroe Creek, a tributary of Monroe Creek and Watercourse A, were identified on and within 120 m of the solar panel Project location.

Monroe Creek

- Munroe Creek was determined to be a permanent stream. Munroe Creek flows in a relatively wide, low lying valley, with abundant wetland vegetation, surrounding by wooded areas adjacent to the agricultural fields on the adjacent properties.
- Munroe Creek meets the definition of a water body, as outlined in the REA Regulation. It would be crossed by the proposed access road and connection lines to the adjoining solar facility.

Therefore, an EIS will be required to assess the potential negative effects of the Project on the creek and lands within 30 m of the average annual high water mark.

Tributary of Monroe Creek

- The Tributary of Monroe Creek was confirmed, and it appeared to be an intermittent stream. The proposed Project Location is situated outside of the 30 m setback area of the average annual high water mark of the tributary.
- An EIS will be required to assess the potential negative effects of the Project on the creek and lands within 30 m of the average annual high water mark.

Watercourse A

- The presence of Watercourse A, an intermittent stream, was confirmed during the site investigations. Watercourse A occurs on the northwestern portion of the Project Location. It appears to be a man-made ditch that utilizes the natural contours of the land to help facilitate surface water drainage from the adjacent agricultural fields.
- It was determined to be an intermittent stream that likely receives flow after heavy precipitation events, and is dry the remaining months of the year. The watercourse did not appear to be connected to the municipal ditch.
- The proposed development area will occur within 30 to 120 m of the average annual high water mark of Watercourse A. Therefore, an EIS will be required to assess the potential negative effects of the Project on the creek and lands within 30 m of the average annual high water mark.

Transmission Line Project Location

- There were 36 unnamed watercourses, the Frederickhouse River and Deception Creek. In addition, the proposed transmission line will pass within 120 m of Lower Deception Lake.

3. Conclusions

Based on the results of the site investigation and the proposed Project location, some components of the Project will be located between 30 and 120 m of the average annual high water mark of the Monroe Creek, tributary of Monroe Creek, Watercourse A and 38 watercourses regarding the transmission line Project location. Therefore, an EIS will be required to assess the potential effects of the Project and the required mitigation measures to prevent or minimize adverse effects on these waterbodies.

Appendix K
Water Body
Environmental Impact Study
Summaries

**Northland Power Inc.
Abitibi Solar Project****Summary****Water Body Environmental Impact Study****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Waterbodies Environmental Impact Study for the Abitibi Solar Project.

Northland Power Solar Abitibi L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the District of Cochrane, titled the Abitibi Solar Project (hereinafter referred to as the “Project”). The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the “solar panel Project location.” The solar panel Project location is approximately 98 hectares (ha) in size and located on Lots 14 and 15, Concession 8 of the Town of Cochrane on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20-km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Sections 39 and 40 of the REA Regulation require proponents of Class 3 solar projects to complete an Environmental Impact Study (EIS) for all waterbodies determined to be within a specified setback in order to obtain a REA. The EIS is required in order to determine (i) any potential negative environmental effects on the natural features (ii) identify mitigation measures (iii) describe how the environmental effects monitoring plan in the Design and Operations Report addresses any negative environmental effects and (iv) describe how the Construction Plan Report addresses any negative environmental effects.

This EIS was completed on the impact to (i) surface water runoff (patterns and rates), (ii) surface water quality, (iii) aquatic and riparian habitat and biota and (iv) groundwater from the presence of the Project.

2. Results

The results of the EIS on the water bodies are summarized in Table 2.1.

Table 2.1 Summary of Potential Negative Environmental Effects and Proposed Mitigation

Negative Effect	Mitigation Strategy
Construction Phase	
Increases in surface water runoff from the construction site	Stormwater management measures including grassed swales, enhanced vegetated swales, ditch flow controls and filter strips, and temporary construction measures as necessary (e.g., hay bales).
Soil compaction due to heavy equipment use and stockpiling	Remediation of compaction following construction.
Erosion and sedimentation resulting in increased turbidity in site runoff	Erosion and sediment control measures.
Dust generation and off-site transport	Standard construction site best management practices to prevent fugitive dust .
Potential for adverse surface water and ground water quality due to accidental spills	Standard mitigation to prevent spills and minimize magnitude of spills that do occur.
Operation Phase	
Increases in surface water runoff from Project site	Stormwater management measures including grassed swales, enhanced vegetated swales and filter strips.
Erosion and sedimentation resulting in increased turbidity in site runoff	Vegetation to prevent erosion due to stormwater.
Potential for adverse surface water and ground water quality due to accidental spills	Standard mitigation to prevent spills and minimize magnitude of spills that do occur.
Decommissioning Phase	
Erosion and sedimentation resulting in increased turbidity in site runoff	Erosion and sediment control measures.
Potential for adverse surface water and ground water quality due to accidental spills	Standard mitigation to prevent spills and minimize magnitude of spills that do occur.

Table 5.1 in the EIS summarizes the proposed monitoring plan.

As discussed in the Design and Operations Report, environmental effects monitoring is proposed in respect of any negative environmental effects that may result from engaging in the Project. The monitoring plan in the Design and Operations Report identifies: performance objectives in respect of the negative environmental effects; mitigation measures to assist in achieving the performance objectives; and, a program for monitoring negative environmental effects for the duration of the time the Project is engaged in, including a contingency plan to be implemented if any mitigation measures fail.

In addition, the Construction Plan Report for the Project details the construction and installation activities, location and timing of construction and installation activities, any negative environmental effects that result from construction activities within 300 m of the Project and mitigation measures for the identified negative environmental effects.

3. Conclusions

The EIS has been prepared to identify potential negative environmental effects that all phases of the Project may have on waterbodies. Mitigation measures have been proposed to prevent these effects from occurring or minimize the magnitude, extent, duration and frequency in the event that they do occur. The primary mitigation measure that will prevent adverse effects on the waterbodies is adherence to the 30-m setback requirement for solar panels, inverters and transformers. Monitoring

measures have been proposed to confirm that mitigation measures are having the intended effect and that performance objectives are being met.

Overall, while the Project will result in some changes to the natural environment, no negative effects on waterbodies are anticipated to occur following implementation of the mitigation and monitoring measures proposed in this EIS.

**Northland Power Inc.
Empire Solar Project****Summary****Water Body Environmental Impact Study****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Waterbodies Environmental Impact Study for the Empire Solar Project.

Northland Power Solar Empire L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the Town of Cochrane. This Project, known as the Empire Solar Project, is hereafter referred to as the “Project.” The Project location is comprised of two primary components. The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the “solar panel Project location”. The solar panel Project location is approximately 122 hectares (ha) in size and located on Lots 17 and 18, Concession 7 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 7.

The second part of the Project is the approximately 20 km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Sections 39 and 40 of the REA Regulation require proponents of Class 3 solar projects to complete an Environmental Impact Study (EIS) for all waterbodies determined to be within a specified setback in order to obtain a REA. The EIS is required in order to determine (i) any potential negative environmental effects on the natural features (ii) identify mitigation measures (iii) describe how the environmental effects monitoring plan in the Design and Operations Report addresses any negative environmental effects and (iv) describe how the Construction Plan Report addresses any negative environmental effects.

This EIS was completed on the impact to (i) surface water runoff (patterns and rates), (ii) surface water quality, (iii) aquatic and riparian habitat and biota and (iv) groundwater from the presence of the Project.

2. Results

The results of the EIS on the water bodies are summarized in Table 2.1.

Table 2.1 Summary of Potential Negative Environmental Effects and Proposed Mitigation

Negative Effect	Mitigation Strategy
Construction Phase	
Increases in surface water runoff from the construction site	Stormwater management measures including grassed swales, enhanced vegetated swales, ditch flow controls and filter strips, and temporary construction measures as necessary (e.g., hay bales).
Soil compaction due to heavy equipment use and stockpiling	Remediation of compaction following construction.
Erosion and sedimentation resulting in increased turbidity in site runoff	Erosion and sediment control measures.
Dust generation and off-site transport	Standard construction site best management practices to prevent fugitive dust (see Section 4.2.1.2).
Adverse effects on aquatic habitat and biota due to access road upgrading	Work in water and culvert installation best management practices and habitat enhancements.
Potential for adverse surface water and ground water quality due to accidental spills	Standard mitigation to prevent spills and minimize magnitude of spills that do occur (see Section 4.2.1.3).
Operation Phase	
Increases in surface water runoff from Project site	Stormwater management measures including grassed swales, enhanced vegetated swales and filter strips.
Erosion and sedimentation resulting in increased turbidity in site runoff	Vegetation to prevent erosion due to stormwater.
Potential for adverse surface water and ground water quality due to accidental spills	Standard mitigation to prevent spills and minimize magnitude of spills that do occur.
Decommissioning Phase	
Erosion and sedimentation resulting in increased turbidity in site runoff	Erosion and sediment control measures.
Potential for adverse surface water and ground water quality due to accidental spills	Standard mitigation to prevent spills and minimize magnitude of spills that do occur.

Table 5.1 in the EIS summarizes the proposed monitoring plan.

As discussed in the Design and Operations Report, environmental effects monitoring is proposed in respect of any negative environmental effects that may result from engaging in the Project. The monitoring plan in the Design and Operations Report identifies: performance objectives in respect of the negative environmental effects; mitigation measures to assist in achieving the performance objectives; and, a program for monitoring negative environmental effects for the duration of the time the Project is engaged in, including a contingency plan to be implemented if any mitigation measures fail.

In addition, the Construction Plan Report for the Project details the construction and installation activities, location and timing of construction and installation activities, any negative environmental effects that result from construction activities within 300 m of the Project and mitigation measures for the identified negative environmental effects.

3. Conclusions

The EIS has been prepared to identify potential negative environmental effects that all phases of the Project may have on waterbodies. Mitigation measures have been proposed to prevent these effects from occurring or minimize the magnitude, extent, duration and frequency in the event that they do occur. The primary mitigation measure that will prevent adverse effects on the waterbodies is adherence to the 30-m setback requirement for solar panels, inverters and transformers. Monitoring measures have been proposed to confirm that mitigation measures are having the intended effect and that performance objectives are being met.

Overall, while the Project will result in some changes to the natural environment, no negative effects on waterbodies are anticipated to occur following implementation of the mitigation and monitoring measures proposed in this EIS.

**Northland Power Inc.
Martin's Meadows Solar Project
Summary**

Water Body Environmental Impact Study

1. Introduction

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Waterbodies Environmental Impact Study for the Martin's Meadows Solar Project.

Northland Power Solar Martin's Meadows L.P. (hereinafter referred to as "Northland") is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic facility in the Town of Cochrane. This Project, known as the Martin's Meadows Solar Project, is hereafter referred to as "Martin's Meadows" or the "Project". The first part of the Project is the location of the solar panels, including access roads, inverters, transformers, fencing, etc, and is hereafter referred to as the "solar panel Project location". The solar panel Project location is approximately 82 hectares (ha) in size and located on Lot 16, Concession 8 of the Town of Cochrane. The solar panel Project location is situated on Glackmeyer Concession Road 9.

The second part of the Project is the approximately 20-km transmission line from the solar panel Project location to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station. This portion of the project is referred to as the transmission line Project location.

Sections 39 and 40 of the REA Regulation require proponents of Class 3 solar projects to complete an Environmental Impact Study (EIS) for all waterbodies determined to be within a specified setback in order to obtain a REA. The EIS is required in order to determine (i) any potential negative environmental effects on the natural features (ii) identify mitigation measures (iii) describe how the environmental effects monitoring plan in the Design and Operations Report addresses any negative environmental effects and (iv) describe how the Construction Plan Report addresses any negative environmental effects.

This EIS was completed on the impact to (i) surface water runoff (patterns and rates), (ii) surface water quality, (iii) aquatic and riparian habitat and biota and (iv) groundwater from the presence of the Project.

2. Results

The results of the EIS on the waterbodies are summarized in Table 2.1.

Table 2.1 Summary of Potential Negative Environmental Effects and Proposed Mitigation

Negative Effect	Mitigation Strategy
Construction Phase	
Increases in surface water runoff from the construction site	Stormwater management measures including grassed swales, enhanced vegetated swales, ditch flow controls and filter strips, and temporary construction measures as necessary (e.g., hay bales).
Soil compaction due to heavy equipment use and stockpiling	Remediation of compaction following construction.
Erosion and sedimentation resulting in increased turbidity in site runoff	Erosion and sediment control measures.
Dust generation and off-site transport	Standard construction site best management practices to prevent fugitive dust.
Potential for adverse surface water and ground water quality due to accidental spills	Standard mitigation to prevent spills and minimize magnitude of spills that do occur.
Operation Phase	
Increases in surface water runoff from Project site	Stormwater management measures including grassed swales, enhanced vegetated swales and filter strips.
Erosion and sedimentation resulting in increased turbidity in site runoff	Vegetation to prevent erosion due to stormwater.
Potential for adverse surface water and ground water quality due to accidental spills	Standard mitigation to prevent spills and minimize magnitude of spills that do occur.
Decommissioning Phase	
Erosion and sedimentation resulting in increased turbidity in site runoff	Erosion and sediment control measures.
Potential for adverse surface water and ground water quality due to accidental spills	Standard mitigation to prevent spills and minimize magnitude of spills that do occur.

Table 5.1 in the EIS summarizes the proposed monitoring plan.

As discussed in the Design and Operations Report, environmental effects monitoring is proposed in respect of any negative environmental effects that may result from engaging in the Project. The monitoring plan in the Design and Operations Report identifies: performance objectives in respect of the negative environmental effects; mitigation measures to assist in achieving the performance objectives; and, a program for monitoring negative environmental effects for the duration of the time the Project is engaged in, including a contingency plan to be implemented if any mitigation measures fail.

In addition, the Construction Plan Report for the Project details the construction and installation activities, location and timing of construction and installation activities, any negative environmental effects that result from construction activities within 300 m of the Project and mitigation measures for the identified negative environmental effects.

3. Conclusions

The EIS has been prepared to identify potential negative environmental effects that all phases of the Project may have on waterbodies. Mitigation measures have been proposed to prevent these effects from occurring or minimize the magnitude, extent, duration and frequency in the event that they do occur. The primary mitigation measure that will prevent adverse effects on the waterbodies is adherence to the 30-m setback requirement for solar panels, inverters and transformers. Monitoring

measures have been proposed to confirm that mitigation measures are having the intended effect and that performance objectives are being met.

Overall, while the Project will result in some changes to the natural environment, no negative effects on waterbodies are anticipated to occur following implementation of the mitigation and monitoring measures proposed in this EIS.

Appendix L
Stage 1 and 2
Archaeological Assessment Report
Summaries

**Northland Power Inc.
Abitibi Solar Project****Summary****Stage 1 and 2 Archaeological Assessment Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Archaeological Assessment Report, prepared by Archaeological Research Associates for the Abitibi Solar Project.

Northland Power Solar Abitibi L.P. (hereinafter referred to as “Northland”) is proposing to develop a 10-megawatt (MW) solar photovoltaic project titled Abitibi Solar Project (hereinafter referred to as the “Project”). The Project is located on Glackmeyer Concession Road 9, in the Town of Cochrane.

Section 22 of the REA Regulation requires proponents of Class 3 solar projects to undertake an Archaeological Assessment where there is a concern that an undertaking could impact archaeological resources. The purpose of the present assessment was to confirm the presence or absence of significant archaeological resources that could represent potential constraints for the proposed Abitibi Solar Project. The assessment included a Stage 1 background study of past archaeological investigations and known archaeological sites within a 2-km radius of the Abitibi Solar Project site. It also included a systematic 5-m interval Stage 2 archaeological survey of all of the Leased Lands in the property.

2. Results

The Stage 1 research indicated a high potential for the presence of both Pre-Contact and Euro-Canadian archaeological sites in the study area. During the Stage 2 assessment, no archaeological material was identified.

3. Conclusions

The office of the Ministry of Tourism and Culture has reviewed the Archaeological Assessment Report in accordance with Part VI of the Ontario Heritage Act, R.S.O. 1990, c 0.18, and accepted its findings.

**Northland Power Inc.
Empire Solar Project****Summary****Stage 1 and 2 Archaeological Assessment Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Archaeological Assessment Report, prepared by Archaeological Research Associates for the Empire Solar Project.

Northland Power Solar Empire L.P. (hereinafter referred to as “Northland”) is proposing to develop a Class 3 10-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the Town of Cochrane. This Project, known as the Empire Solar Project, is hereafter referred to as the “Project.”

Section 22 of the REA Regulation requires proponents of Class 3 solar projects to undertake an Archaeological Assessment where there is a concern that an undertaking could impact archaeological resources. The purpose of the present assessment was to confirm the presence or absence of significant archaeological resources that could represent potential constraints for the proposed Project. The assessment included a Stage 1 background study of past archaeological investigations and known archaeological sites within a 2-km radius of the Project. It also included a systematic 5-m interval Stage 2 archaeological survey of all of the Leased Lands in the property.

2. Results

The Stage 1 research indicated a high potential for the presence of both Pre-Contact and Euro-Canadian archaeological sites in the study area. During the Stage 2 assessment, no archaeological material was identified.

3. Conclusions

The office of the Ministry of Tourism Culture and Sport has reviewed the Archaeological Assessment Report in accordance with Part VI of the Ontario Heritage Act, R.S.O. 1990, c 0.18, and accepted its findings.

**Northland Power Inc.
Empire Solar Project****Summary****Stage 1 and 2 Archaeological Assessment Report
for Additional Lands****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Archaeological Assessment Report, prepared by The Archaeologists Inc. for the additional lands of the Empire Solar Project.

Section 22 of the REA Regulation requires proponents of Class 3 solar projects to undertake an Archaeological Assessment where there is a concern that an undertaking could impact archaeological resources. The purpose of the present assessment was to confirm the presence or absence of significant archaeological resources that could represent potential constraints for the additional lands of the Project. The assessment included a Stage 1 background study about the property's geography, history, previous archaeological fieldwork and current land condition in order to evaluate the Project's archaeological potential. The Stage 2 assessment consisted of a test pit survey strategy for northern Ontario and Canadian Shield terrain.

2. Results

The Stage 1 background study concluded that the property shows archaeological potential. The Stage 2 property assessment did not identify any archaeological resources within the 13.35 ha of the additional lands. The report recommends that no further archaeological assessment of the subject property is required.

3. Conclusions

The office of the Ministry of Tourism, Culture and Sport has reviewed the Archaeological Assessment Report in accordance with Part VI of the Ontario Heritage Act, R.S.O. 1990, c 0.18, and accepted its findings.

**Northland Power Inc.
Martin's Meadows Solar Project**

Summary

Stage 1 and 2 Archaeological Assessment Report

1. Introduction

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Archaeological Assessment Report, prepared by Archaeological Research Associates for the Martin's Meadows Solar Project.

Northland Power Solar Martin's Meadows L.P. (hereinafter referred to as "Northland") is proposing to develop a 10-megawatt (MW) solar photovoltaic project titled Martin's Meadows Solar Project (hereinafter referred to as the "Project"). The Project is located on Glackmeyer Concession Road 9, in the Town of Cochrane.

Section 22 of the REA Regulation requires proponents of Class 3 solar projects to undertake an Archaeological Assessment where there is a concern that an undertaking could impact archaeological resources. The purpose of the present assessment was to confirm the presence or absence of significant archaeological resources that could represent potential constraints for the proposed Abitibi Solar Project. The assessment included a Stage 1 background study of past archaeological investigations and known archaeological sites within a 2-km radius of the Martin's Meadows Solar Project site. It also included a systematic 5-m interval Stage 2 archaeological survey of all of the Leased Lands in the property.

2. Results

The Stage 1 research indicated a high potential for the presence of both Pre-Contact and Euro-Canadian archaeological sites in the study area. During the Stage 2 assessment, no archaeological material was identified.

3. Conclusions

The office of the Ministry of Tourism and Culture has reviewed the Archaeological Assessment Report in accordance with Part VI of the Ontario Heritage Act, R.S.O. 1990, c 0.18, and accepted its findings.

**Northland Power Inc.
Cochrane Solar Project****Summary****Stage 1 and 2 Archaeological Assessment Report****1. Introduction**

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Archaeological Assessment Report, prepared by The Archaeologists Inc. for the Empire Solar Project.

Northland Power Solar Abitibi L.P., Northland Power Solar Empire L.P., and Northland Power Solar Martin's Meadows L.P. (hereinafter collectively referred to as "Northland") are proposing to develop a 30-megawatt (MW) AC solar photovoltaic project titled the "Cochrane Solar Project" (hereinafter referred to as the "Project"). The Project will be developed on three separate properties (Abitibi, Empire and Martin's Meadows), each with a maximum nameplate capacity of 10-MW AC, and each with a separate OPA FIT contract.

A 21-km long 115-kV transmission line and associated infrastructure is proposed to connect the Project to an existing 115-kV Hydro One Networks Inc. (HONI) transmission line (circuit C2H) north of Hunta, ON.

The Project was formerly submitted to the MOE as three, individual 10-MW projects known as the Abitibi Solar Project, the Empire Solar Project and the Martin's Meadows Solar Project. As the three developments are in close proximity to one another and connect to a common transmission line, they are being integrated as one Project as per Section 4(3) of Ontario Regulation 359/09.

Section 22 of the REA Regulation requires proponents of Class 3 solar projects to undertake an Archaeological Assessment where there is a concern that an undertaking could impact archaeological resources. The purpose of the present assessment was to confirm the presence or absence of significant archaeological resources that could represent potential constraints for the Empire property of the proposed Cochrane Solar Project. The assessment included a Stage 1 background study of past archaeological investigations and known archaeological sites within a 2-km radius of the Empire property. It also included a judgmental test pit survey at maximum intervals of 10 m to confirm its low and wet condition.

2. Results

The Stage 1 research indicated a potential for the presence of both Pre-Contact and Euro-Canadian archaeological sites in the study area. During the Stage 2 assessment, no archaeological material was identified.

3. Conclusions

The office of the Ministry of Tourism, Culture, and Sport has reviewed the Archaeological Assessment Report in accordance with Part VI of the Ontario Heritage Act, R.S.O. 1990, c 0.18, and accepted its findings.

Appendix M
Transmission Line -
Stage 1 and 2 Archaeological Assessment
Report Summary

**Northland Power Inc.
Transmission Line for Abitibi, Empire
and Martin's Meadows Solar Project**

Summary

Transmission Line - Stage 1 and 2 Archaeological Assessment Report

1. Introduction

As per Section 17 of the Renewable Energy Approvals (REA) Regulation (O. Reg. 359/09) under Part V.0.1 of the *Environmental Protection Act*, the following is a summary of the Archaeological Assessment Report, prepared by Archaeological Research Associates for the 115-kV Transmission Line for the Abitibi, Empire and Martin's Meadows Solar Projects.

The 115-kV transmission line will service the Abitibi, Empire and Martin's Meadows Solar Projects. This 115 kV line is located within the District of Cochrane.

Section 22 of the REA Regulation requires proponents of Class 3 solar projects to undertake an Archaeological Assessment where there is a concern that an undertaking could impact archaeological resources. The purpose of the present assessment was to confirm the presence or absence of significant archaeological resources that could represent potential constraints for the proposed 115-kV transmission line. The assessment included a Stage 1 background study of past archaeological investigations and known archaeological sites within a 2-km radius of the 115-kV transmission line Project. It also included a test pit survey for all of the 115-kV transmission line lands.

2. Results

The Stage 1 research indicated that in the Project land contains a mixture of areas for high archaeological potential and areas with no archaeological potential due to past man-made disturbances. The Stage 2 was conducted on all lands with the potential to be impacted by the Project. During the Stage 2 assessment, no archaeological material was identified.

3. Conclusions

The office of the Ministry of Tourism, Culture and Sport has reviewed the Archaeological Assessment Report in accordance with Part VI of the Ontario Heritage Act, R.S.O. 1990, c 0.18, and accepted its findings.

Appendix N

Noise Assessment Summary

Northland Power Inc Cochrane Solar Project

Summary

Noise Assessment Report

1. Introduction

This report presents the results of the noise assessment study for the Cochrane Solar Project, required under Regulation 359/09 as part of the Renewable Energy Approval Process (REA).

Northland Power Solar Abitibi L.P., Northland Power Solar Empire L.P. and Northland Power Solar Martin's Meadows L.P. (hereinafter referred to as "Northland") are proposing to develop a Class 3 30-megawatt (MW) ground mounted solar photovoltaic (Solar PV) facility in the District of Cochrane, titled the Cochrane Solar Project (hereinafter referred to as the "Project"). The Project will be developed on three separate properties (Abitibi, Empire and Martin's Meadows), each with a maximum nameplate capacity of 10-MW AC, and each with a separate OPA FIT contract. The Project is located on Lots 14, 15, and 16, Concession 8, and Lots 17 and 18, Concession 7 of the Town of Cochrane. There is an approximately 20-km transmission line from the location of the solar panels to the connection point west of the Project location near Hunta, ON, as well as associated transition structure and switching station.

This Noise Impact Assessment has been prepared based on the document entitled "Basic Comprehensive Certificates of Approval (Air) – User Guide" by the Ontario Ministry of the Environment (MOE), which requires that the sound pressure levels at the points of reception (POR) are estimated using ISO 9613-2. The performance limits used for verification of compliance correspond to the values for Class 3 areas (45 dBA for day time, 40 dBA for night time) as established by MOE.

2. Results

- The main sources of noise from the Project will be the 25 inverter clusters, each one containing two inverters and one medium-voltage transformer, and a substation containing the main step-up transformer.
- The Project will be located in a Class 3 Area. Class 3 area means a rural area with an acoustical environment that is dominated by natural sounds, having little or no traffic, such as an agricultural area.
- Twenty-five inverter clusters will be installed as part of the Project. Each cluster comprises of two SMA Sunny Central 800CP inverters and one medium voltage transformer. A 1.6-MVA transformer used to step-up the 360-V power from the inverters to 27.6 kV will be located in proximity to the inverters. One 10-MVA/115-kV substation transformer will step-up the 27.6-kV

power collected from the inverter clusters to 115-kV prior to being sent to the existing local transmission line.

- At night time the facility will not operate. Under these conditions the inverters do not produce noise. The transformers (at the substation and clusters) are energized and make some magnetostrictive noise at a reduced level, but no cooling fans are in operation.
- The sound pressure levels at the points of reception have been estimated using the CADNA-A model, based on ISO 9613-2. The performance limits used for comparison correspond to Class 3 areas, with 45 dBA during day time (7:00 a.m. to 7:00 p.m.) and 40 dBA during night time. It has been determined that no mitigation measures are needed for the Project operation.

3. Conclusions

Based on the results obtained in this study, it is concluded that the sound pressure levels at the POR will be well below MOE requirements for Class 3 areas at both night time and day time (40 dBA and 45 dBA, respectively).

Appendix O
Protected Properties and
Heritage Resource Information

Project Report

January 25, 2013

**Northland Power Inc.
Cochrane Solar Project**

Protected Properties and Heritage Resources Report

Table of Contents

1. Introduction	3
1.1 Project Description	3
1.2 REA Legislative Requirements	3
2. Protected Properties.....	4
3. Heritage Resources	4
4. Conclusion	4

Blank back

1. Introduction

1.1 Project Description

Northland Power Solar Abitibi L.P., Northland Power Solar Empire L.P., and Northland Power Solar Martin's Meadows L.P. (hereinafter collectively referred to as "Northland") are proposing to develop a 30-megawatt (MW) AC solar photovoltaic project titled the "Cochrane Solar Project" (hereinafter referred to as the "Project"). The Project will be developed on three separate properties (Abitibi, Empire and Martin's Meadows), each with a maximum nameplate capacity of 10-MW AC, and each with a separate OPA FIT contract.

A 21-km long 115-kV transmission line and associated infrastructure is proposed to connect the Project to an existing 115-kV Hydro One Networks Inc. (HONI) transmission line (circuit C2H) north of Hunta, ON.

The Project was formerly submitted to the MOE as three, individual 10-MW projects known as the Abitibi Solar Project, the Empire Solar Project and the Martin's Meadows Solar Project. As the three developments are in close proximity to one another and connect to a common transmission line, they are being integrated as (one Project as per Section 4(3) of Ontario Regulation 359/09.

The Abitibi and the Martin's Meadows properties are located on Glackmeyer Concession Road 8/9, in the Town of Cochrane. The Empire property is located on Glackmeyer Concession Road 6/7, in the Town of Cochrane. The 115-kV transmission line will be located primarily along opened and unopened road allowances associated with Concession 8/9 from the locations of the three solar development properties in the Town of Cochrane, through the Unorganized Township of Clute, to the connection point located north of Hunta, ON in the Unorganized Township of Calder. Some private land outside of the road allowances will be used for the transmission line, primarily associated with the movement of the line around the southern end of Lower Deception Lake, as well as for the associated infrastructure (such as transition structures and switching station).

The Project will use solar photovoltaic technology to generate electricity. Each of the three solar developments will use solar modules mounted on fixed steel supports and arranged in 7 "power or inverter blocks" on each property. Each inverter block will have two inverters rated at 0.714 MW AC and one transformer. Northland will continue to consider mounting solar modules onto a solar tracking support system, however this report has been prepared assuming the use of a fixed steel support structure with modules at a fixed tilt. Electricity generated by the solar photovoltaic modules from the solar arrays will be converted from direct current (DC) to alternating current (AC) by an inverter, and subsequently stepped up from a medium voltage of 27.6 kV to 115 kV, in order to connect to the HONI transmission system via the previously described transmission line.

1.2 REA Legislative Requirements

Ontario Regulation (O. Reg.) 359/09 – *Renewable Energy Approvals Under Part V.0.1 of the Act*, (herein referred to as the REA Regulation) made under the *Environmental Protection Act* identifies the Renewable Energy Approval (REA) requirements for projects in Ontario. As per Section 4 of the REA Regulation, ground mounted solar facilities with a name plate capacity greater than 10 kilowatts (kW) are classified as Class 3 solar facilities and do require an REA.

Section 19 of the REA Regulation requires proponents of Class 3 solar facilities to determine whether the Project location is on a property (“protected property”) described in Column 1 of the Table to Section 19. Section 23 of the REA requires that proponents of Class 3 solar projects, as a result of the consideration mentioned in subsection 20, determine whether engaging in the renewable energy project may have an impact on a heritage resource described in subsection 20(1).

In June 2011, the Ministry of Tourism and Culture (MTC) released *An Information Bulletin for Applicants Addressing the Cultural Heritage Component of Projects Subject to Ontario Regulation 359/09 Renewable Energy Approvals*. The applicable identification and self-assessment processes described in Parts 1, 3B and 4 of this Bulletin have been completed to satisfy the requirements of the MTC with respect to the consideration of Protected Properties and Heritage Resources under the REA Regulation. Findings are presented in Tables 1.1, 1.2 and 1.3 of this report.

As per MTC’s Information Bulletin, “Project location” is defined as per Ontario Regulation 359/09, “as part of land and all or part of any building or structure in, on or over which the REA applicant engages or proposed to engage in the project and any air space in which a person is engaging in or proposes to engage in the project”. All phases of the project (i.e. construction, operation and decommissioning) must be considered.

2. Protected Properties

Resources used to determine whether the Project location was on or abutting Protected Properties described in Column 1 of the Table to Section 19 included internet searches of various Provincial and Municipal websites in addition to Municipal consultation as directed within Appendix B of the MTC’s Information Bulletin (June 2011). As discussed in Section 1.2 above, Tables 1.1 and 1.2 have been prepared to address Section 19 of the REA Regulation.

3. Heritage Resources

Resources used to determine whether the Project may or will impact heritage resources at the Project location included (i) internet searches of various Federal, Provincial and Municipal websites among others; (ii) Archaeological Assessments conducted for the Project location; (iii) consultation with the Town of Cochrane, as directed within Appendix B of the MTC’s Information Bulletin (June 2011). As discussed in Section 1.2 above, Table 1.3 has been prepared to address Section 23 of the REA Regulation.

4. Conclusion

Based on the information presented in Tables 1.1 and 1.2, the proposed Project is not located on a Protected Property as described in Column 1 of the Table to Section 19. Hatch contacted all of the appropriate people or bodies and has determined that the Project is not located on the applicable type(s) of protected property.

In addition, research and agency consultation undertaken as described within Table 1.3 has not identified the need for a heritage impact assessment under Section 23 of the REA Regulation.

Table 1.1 Identifying Protected Properties at the Project Location

Project Name: Cochrane Solar Project

Project Location: longitude & latitude: 49.140073 and -80.971227 (Abitibi Property), 49.127954 and -80.994305 (Empire Property), and 49.141101 and -80.984888 (Martin’s Meadows Property)

REA Project Identifier: n/a

Type and Classification of Project: Class 3 Solar Facility

Proponent Name: Northland Power Solar Abitibi L.P., Northland Power Solar Empire L.P., and Northland Power Solar Martin’s Meadows L.P. (respectively)

Proponent Contact Info:

Rob Miller, Manager, Solar Development
Northland Power Inc.
30 St. Clair Ave. West, 17th Floor
Toronto, ON M4V 3A1
647-288-1066

If you answer YES to any of the following questions you will require: either written authorization as set out in the Table in section 19 of O. Reg. 359/09, or written confirmation that written authorization is not required. Continue until all questions are answered for each property at the project location.

Description of Property	YES	NO	Reference
Is the property subject to an Ontario Heritage Trust easement agreement?		✓	According to the Ontario Heritage Trust website (http://www.heritagetrust.on.ca/Home.aspx) no easement properties are located in the vicinity of the Project properties. In addition, the Ontario Heritage Properties Database did not reveal any easement properties. (Research completed May 14, 2012).
Has a notice of intention to designate been issued by a municipality for the property?		✓	Consultation with the municipality indicated that there are no heritage concerns within the Town boundaries and that there are no heritage sites being proposed within the Town. No such authority exists for areas in unorganized townships.
Is the property municipally designated?		✓	Consultation with the municipality indicated that there are no heritage concerns within the Town boundaries and that there are no heritage sites being proposed within the Town. No such authority exists for areas in unorganized townships.
Is the property provincially designated?		✓	As per Appendix G of the ‘Protected Properties, Archaeological and Heritage Resources An Information Bulletin for Applicants Addressing the Cultural Heritage Component of Projects Subject to <i>Ontario Regulation 359/09 Renewable Energy Approvals</i> ’ (2011), no properties have been designated under Section 34.5 of the <i>Ontario Heritage Act</i> .
Has a notice of intention to designate been issued by the Ministry of Tourism and Culture for the property?		✓	As per Appendix G of the ‘Protected Properties, Archaeological and Heritage Resources An Information Bulletin for Applicants Addressing the Cultural Heritage Component of Projects Subject to <i>Ontario Regulation 359/09 Renewable Energy Approvals</i> ’ (2011), a notice of intention to designate has not occurred for the Project location.

Description of Property	YES	NO	Reference
Is the property located within a designated Heritage Conservation District?		✓	Ongoing consultation is occurring with the Town of Cochrane to confirm the Project location is not part of a Heritage Conservation District. However, no properties are listed under Part V of the Ontario Heritage Act (http://www.mtc.gov.on.ca/en/heritage/heritage_conserving_list.shtml). No such authority exists for areas in unorganized townships.
Is the property designated as a historic site under Regulation 880?		✓	As per Appendix G of the <i>Protected Properties, Archaeological and Heritage Resources: An Information Bulletin for Applicants Addressing the Cultural Heritage Component of Projects Subject to Ontario Regulation 359/09 Renewable Energy Approvals</i> (2011), there are only three sites designated as a historic site under Regulation 880, and these three sites do not occur within the Project location.

Table 1.2 Identifying Protected Properties Abutting a Project Location

Project Name: Cochrane Solar Project

Project Location: longitude & latitude: 49.140073 and -80.971227 (Abitibi Property), 49.127954 and -80.994305 (Empire Property), and 49.141101 and -80.984888 (Martin's Meadows Property)

REA Project Identifier: n/a

Type and Classification of Project: Class 3 Solar Facility

Proponent Name: Northland Power Solar Abitibi L.P., Northland Power Solar Empire L.P., and Northland Power Solar Martin's Meadows L.P. (respectively)

Proponent Contact Info:

Rob Miller, Manager, Solar Development

Northland Power Inc.

30 St. Clair Ave. West, 17th Floor

Toronto, ON M4V 3A1

647-288-1066

If you answer YES to any of the following questions a heritage assessment is required.

Description of Property	YES	NO	Reference
Is there an abutting subject to an Ontario Heritage Trust easement agreement?		✓	The Ontario Heritage Trust website (http://www.heritagetrust.on.ca/Home.aspx) was searched on May 14, 2012 for easement agreements. The query did not identify any easements abutting the Project location.
Is there an abutting property for which a notice of intention to designate been issued by a municipality?		✓	Consultation with the municipality indicated that there are no heritage concerns within the Town boundaries and that there are no heritage sites being proposed within the Town. No such authority exists for areas in unorganized townships.
Is there an abutting property that has been municipally designated?		✓	Consultation with the municipality indicated that there are no heritage concerns within the Town boundaries and that there are no heritage sites being proposed within the Town. No such authority exists for areas in unorganized townships.
Is there an abutting property that has been provincially designated?		✓	As per Appendix G of the 'Protected Properties, Archaeological and Heritage Resources An Information Bulletin for Applicants Addressing the Cultural Heritage Component of Projects Subject to <i>Ontario Regulation 359/09 Renewable Energy Approvals</i> ' (2011), no properties have been designated under Section 34.5 of the Ontario Heritage Act.
Is there an abutting property for which a notice of intention to designate has been issued by the Ministry of Tourism and Culture?		✓	As per Appendix G of the 'Protected Properties, Archaeological and Heritage Resources An Information Bulletin for Applicants Addressing the Cultural Heritage Component of Projects Subject to <i>Ontario Regulation 359/09 Renewable Energy Approvals</i> ' (2011), a notice of intention to designate has only been issues to one property, which occurs in the District of Manitoulin, and as such does not occur abutting the Project location.

Description of Property	YES	NO	Reference
Is there an abutting property that is subject to a municipal easement agreement?		✓	Consultation with the municipality indicated that there are no heritage concerns within the Town boundaries and that there are no heritage sites being proposed within the Town. No such authority exists for areas in unorganized townships.
Is there an abutting property that is part of a designated Heritage Conservation District?		✓	Ongoing consultation is occurring with the Town of Cochrane to confirm the Project location is not a part of a Heritage Conservation District. Though, no properties are listed under Part V of the Ontario Heritage Act (http://www.mtc.gov.on.ca/en/heritage/heritage_conserving_list.shtml). No such authority exists for areas in unorganized townships.
Is there an abutting property designated as a historic site under Regulation 880?		✓	As per Appendix G of the 'Protected Properties, Archaeological and Heritage Resources An Information Bulletin for Applicants Addressing the Cultural Heritage Component of Projects Subject to <i>Ontario Regulation 359/09 Renewable Energy Approvals</i> ' (2011), there are only three (3) sites designated as a historic site under Regulation 880, and these three sites do not occur within the Project location.

Table 1.3 Consideration of Heritage Resources at the Project Location: Self-Assessment Checklist

Project Name: Cochrane Solar Project

Project Location: longitude & latitude: 49.140073 and -80.971227 (Abitibi Property), 49.127954 and -80.994305 (Empire Property), and 49.141101 and -80.984888 (Martin’s Meadows Property)

REA Project Identifier: n/a

Type and Classification of Project: Class 3 Solar Facility

Proponent Name: Northland Power Solar Abitibi L.P., Northland Power Solar Empire L.P., and Northland Power Solar Martin’s Meadows L.P. (respectively)

Proponent Contact Info:

Rob Miller, Manager, Solar Development

Northland Power Inc.

30 St. Clair Ave. West, 17th Floor

Toronto, ON M4V 3A1

647-288-1066

Screening Question	Yes	No	Reference
Part A: Recognized Cultural Heritage Value:			
1. Is the project area abutting a protected heritage property as described in the table in section 19 of O. Reg. 359/09?		✓	See Table 1.2.
If you answer YES , a heritage assessment is required. The heritage assessment report and MTC’s written comments must be included in the application. It is not necessary to complete the remaining questions in the checklist.			
If you answer NO , a copy of the correspondence required for Appendix E must be submitted as part of the application. Continue to question 2.			
2. Is the subject property listed on the municipal heritage register, or a provincial register/list?		✓	See Table 1.1.
If you answer YES , a heritage assessment is required. The heritage assessment report and MTC’s written comments must be included in the application. It is not necessary to complete the remaining questions in the checklist.			
If you answer NO , a copy of the printouts/screenshots of all relevant queries must be submitted as part of the application. Continue to question 3.			
3. Is there a municipal, provincial or federal plaque on or related to the subject property?		✓	<p>Consultation with the Town of Cochrane to confirm there is no municipal plaque on or related to the subject properties. No such entity exists for the unorganized township.</p> <p>A search of Ontario Heritage Trust website (http://www.heritagetrust.on.ca/Resources---Learning/Online-Plaque-Guide/Plaque-Information.aspx?searchtext=635) resulted in 0 plaques located within 1 km of the Project location.</p>

Screening Question	Yes	No	Reference
			A search of Parks Canada website (http://www.pc.gc.ca/apps/dfhd/default_eng.aspx) resulted in the determination that there are no federal plaques on or related to the subject properties.
If you answer YES , a heritage assessment is required. The heritage assessment report and MTC's written comments must be included in the application. It is not necessary to complete the remaining questions in the checklist.			
If you answer NO , a copy of correspondence with the Municipality and printouts/screenshots of all relevant queries must be submitted as part of the application. Continue to question 4.			
4. Is the subject property a National Historic Site or a United Nations Educational, Scientific and Cultural Organization (UNESCO) World Heritage Site?		✓	The Project is not located on any National Historic Site or United Nations Educational, Scientific and Cultural Organization (UNESCO) World Heritage Site.
If you answer YES , a heritage assessment is required. The heritage assessment report and MTC's written comments must be included in the application. It is not necessary to complete the remaining questions in the checklist.			
If you answer NO , a copy of printouts/screenshots of all relevant queries and project area information indicating that it is not within the Rideau Canal Corridor must be submitted as part of the application. Continue to question 5.			
Part B: Potential Cultural Heritage Value			
Built Heritage Resources. These are defined as significant buildings, structures, monuments, installations or remains associated with architectural, cultural, social, political, economic or military history and are identified as being important to a community.			
5. Can it be confirmed that buildings at the project location are less than forty years old? Consideration should include:	✓		There are no buildings on the Project location.
a) Residential structures (e.g. house, apartment building, shanty or trap line shelter)		✓	There are no such buildings within the Project location.
b) Farm buildings (e.g. barns, outbuildings, silos, windmills)		✓	There are no such buildings within the Project location.
c) Industrial, commercial or institutional operations (e.g. factory, school, quarry, mining, etc.)		✓	There are no such buildings within the Project location.
d) Engineering works (e.g. bridges, water or communications towers, roads, water/sewer systems, dams, canals, locks, earthworks, etc.)		✓	There are no such buildings within the Project location.
e) Monuments or Landmark Features (e.g. cairns, statues, obelisks, fountains, reflecting pools, retaining walls, boundary or claim markers, etc.)		✓	There are no such features within the Project location.

Screening Question	Yes	No	Reference
If you answer YES , a written summary of historic source materials consulted (with bibliography) must be submitted as part of the application. Continue to Question 6.			
If you answer NO , to any part, a heritage assessment is required. The heritage assessment report and MTC's written comments must be included in the application. It is not necessary to complete the remaining questions in the checklist.			
Cultural Heritage Landscapes. These are defined geographical areas of heritage significance that human activity has modified and that a community values. Such an area involves a grouping(s) of individual heritage features, such as structures, spaces archaeological sites and natural elements, which together form a significant type of heritage form distinct from that of its constituent elements or parts. Examples include: villages, parks, gardens, battlefields, mainstreets and neighbourhoods, cemeteries, trails and industrial complexes of cultural heritage value.			
6. Is there a known burial site and/or cemetery located at or abutting the project location?		✓	Consultation with the municipality confirmed that there are no heritage concerns on the Project location. During field investigation, burial sites and/or cemeteries were not identified.
If you answer YES to any part, a heritage assessment is required. The heritage assessment report and MTC's written comments must be included in the application. It is not necessary to complete the remaining questions in the checklist.			
If you answer NO , a copy of printouts/screenshots of all the database queries must be submitted as part of the application. Continue to question 7.			
7. Is the project location within a Canadian Heritage River watershed?		✓	The Project is not located within the watershed of a Canadian Heritage River.
If you answer YES , a heritage assessment is required. The heritage assessment report and MTC's written comments must be included in the application. It is not necessary to complete the remaining questions in the checklist.			
If you answer NO , a map or correspondence from the appropriate conservation authority or municipal staff indicating that the project area is not located within a Canadian Heritage River watershed must be submitted as part of the application. Continue to Part C.			
Part C: Other Considerations			
The presence/existence of the following at or abutting the project location is an indicator of cultural heritage value or interest. However, they may be more difficult to verify definitively. Many cultural landscape features are readily visible and could be identified during a site visit.			
Is the property or an abutting property associated with a known architect, landscape architect, planner or builder?		✓	There are no buildings within the Project location. In reference to abutting properties, no association with a known architect, landscape architect, planner or builder was discovered over the course of researching the project lands. The municipality did not identify any heritage concerns.
Is the property or an abutting property associated with a historic road or rail corridor?		✓	No, the local area was not developed until the 20 th century.
Is the property or an abutting property a park or planned/designated recreational or community space?		✓	No
Is there accessible documentation to indicate built heritage or cultural heritage landscape potential?		✓	No information was available regarding built heritage or cultural heritage landscape potential.

Screening Question	Yes	No	Reference
Is the subject property or abutting property associated with a person or event of historic interest?		✓	No association with a person or event of historic interest was discovered over the course of researching the project lands, further consultation, with public and/or municipality did not reveal any person or event of historic interest.
<p>If YES to any of the above questions, a heritage assessment is required. If uncertain, additional research is required to make this determination, and a heritage assessment is required. The heritage assessment report and MTC's written comments must be included in the application.</p> <p>If NO to all of the above questions, a heritage assessment is not required.</p>			

Appendix P
Letter of Confirmation –
Ontario Ministry of Natural Resources

Ministry of Natural Resources
Cochrane District

2-4 Highway 11 South
P.O. Box 730
Cochrane ON P0L 1C0

Telephone: 705-272-7137
Facsimile: 705-272-7183
Toll Free: 1-800-667-1940

Ministère des Richesses naturelles
District de Cochrane

2-4 route 11 sud
C.P. 730
Cochrane ON P0L 1C0

Téléphone : 705-272-7137
Télécopieur : 705-272-7183
Sans frais : 1-800-667-1940



May 25, 2012

Mike Lord
General Manager, Solar Development
Northland Power Inc.
30 St. Clair Avenue West
17th Floor
Toronto, Ontario, Canada
M4V 3A1

Dear Mr. Lord:

RE: NHA Confirmation for Abitibi Solar Project

In accordance with the Ministry of the Environment's (MOE's) Renewable Energy Approvals (REA) Regulation (O.Reg.359/09), the Ministry of Natural Resources (MNR) has reviewed the natural heritage assessment and environmental impact study for Abitibi Solar Project in Cochrane submitted by Northland Power Solar Abitibi L.P. on March 19, 2012.

In accordance with Section 28(2) and 38(2)(b) of the REA regulation, MNR provides the following confirmations following review of the natural heritage assessment:

1. The MNR confirms that the determination of the existence of natural features and the boundaries of natural features was made using applicable evaluation criteria or procedures established or accepted by MNR.
2. The MNR confirms that the site investigation and records review were conducted using applicable evaluation criteria or procedures established or accepted by MNR, if no natural features were identified.
3. The MNR confirms that the evaluation of the significance or provincial significance of the natural features was conducted using applicable evaluation criteria or procedures established or accepted by MNR.
4. The MNR confirms that the project location is not in a provincial park or conservation reserve.
5. The MNR confirms that the environmental impact study report has been prepared in accordance with procedures established by the MNR.

This confirmation letter is valid for the project as proposed in the natural heritage assessment and environmental impact study, including those sections describing the Environmental Effects Monitoring Plan and Construction Plan Report. Should any changes be made to the proposed project that would alter the NHA, MNR may need to undertake additional review of the NHA.

Where specific commitments have been made by the applicant in the NHA with respect to project design, construction, rehabilitation, operation, mitigation, or monitoring, MNR expects that these commitments will be considered in MOE's Renewable Energy Approval decision and, if approved, be implemented by the applicant.

In accordance with S.12 (1) of the Renewable Energy Approvals Regulation, this letter must be included as part of your application submitted to the MOE for a Renewable Energy Approval.

Please be aware that your project may be subject to additional legislative approvals as outlined in the Ministry of Natural Resources' *Approvals and Permitting Requirements Document*. These approvals are required prior to the construction of your renewable energy facility.

If you wish to discuss any part of this confirmation or additional comments provided, please contact Jennifer Telford at 705-272-7130.

Yours sincerely,



Martha Heidenheim
A/District Manager
Cochrane District - OMNR

cc. Christine Greenaway, A/Renewable Energy Coordinator, Northeast Region, MNR
Narren Santos, Environmental Assessment and Approvals Branch, MOE
Sandra Guido, Senior Program Support Coordinator, MOE

Ministry of Natural Resources
Cochrane District

2-4 Highway 11 South
P.O. Box 730
Cochrane ON P0L 1C0

Telephone: 705-272-7137
Facsimile: 705-272-7183
Toll Free: 1-800-667-1940

Ministère des Richesses naturelles
District de Cochrane

2-4 route 11 sud
C.P. 730
Cochrane ON P0L 1C0

Téléphone : 705-272-7137
Télécopieur : 705-272-7183
Sans frais : 1-800-667-1940



May 25, 2012

Mike Lord
General Manager, Solar Development
Northland Power Inc.
30 St. Clair Avenue West
17th Floor
Toronto, Ontario, Canada
M4V 3A1

Dear Mr. Lord:

RE: NHA Confirmation for Empire Solar Project

In accordance with the Ministry of the Environment's (MOE's) Renewable Energy Approvals (REA) Regulation (O.Reg.359/09), the Ministry of Natural Resources (MNR) has reviewed the natural heritage assessment and environmental impact study for Empire Solar Project in Cochrane submitted by Northland Power Solar Empire L.P. on March 19, 2012.

In accordance with Section 28(2) and 38(2)(b) of the REA regulation, MNR provides the following confirmations following review of the natural heritage assessment:

1. The MNR confirms that the determination of the existence of natural features and the boundaries of natural features was made using applicable evaluation criteria or procedures established or accepted by MNR.
2. The MNR confirms that the site investigation and records review were conducted using applicable evaluation criteria or procedures established or accepted by MNR, if no natural features were identified.
3. The MNR confirms that the evaluation of the significance or provincial significance of the natural features was conducted using applicable evaluation criteria or procedures established or accepted by MNR.
4. The MNR confirms that the project location is not in a provincial park or conservation reserve.
5. The MNR confirms that the environmental impact study report has been prepared in accordance with procedures established by the MNR.

This confirmation letter is valid for the project as proposed in the natural heritage assessment and environmental impact study, including those sections describing the Environmental Effects Monitoring Plan and Construction Plan Report. Should any changes be made to the proposed project that would alter the NHA, MNR may need to undertake additional review of the NHA.

Where specific commitments have been made by the applicant in the NHA with respect to project design, construction, rehabilitation, operation, mitigation, or monitoring, MNR expects that these commitments will be considered in MOE's Renewable Energy Approval decision and, if approved, be implemented by the applicant.

In accordance with S.12 (1) of the Renewable Energy Approvals Regulation, this letter must be included as part of your application submitted to the MOE for a Renewable Energy Approval.

Please be aware that your project may be subject to additional legislative approvals as outlined in the Ministry of Natural Resources' *Approvals and Permitting Requirements Document*. These approvals are required prior to the construction of your renewable energy facility.

If you wish to discuss any part of this confirmation or additional comments provided, please contact Jennifer Telford at 705-272-7130.

Yours sincerely,



Martha Heidenheim
A/District Manager
Cochrane District - OMNR

cc. Christine Greenaway, A/Renewable Energy Coordinator, Northeast Region, MNR
Narren Santos, Environmental Assessment and Approvals Branch, MOE
Sandra Guido, Senior Program Support Coordinator, MOE

May 25, 2012

Mike Lord
General Manager, Solar Development
Northland Power Inc.
30 St. Clair Avenue West
17th Floor
Toronto, Ontario, Canada
M4V 3A1

Dear Mr. Lord:

RE: NHA Confirmation for Martin's Meadows Solar Project

In accordance with the Ministry of the Environment's (MOE's) Renewable Energy Approvals (REA) Regulation (O.Reg.359/09), the Ministry of Natural Resources (MNR) has reviewed the natural heritage assessment and environmental impact study for Martin's Meadows Solar Project in Cochrane submitted by Northland Power Solar Martin's Meadows L.P. on March 19, 2012.

In accordance with Section 28(2) and 38(2)(b) of the REA regulation, MNR provides the following confirmations following review of the natural heritage assessment:

1. The MNR confirms that the determination of the existence of natural features and the boundaries of natural features was made using applicable evaluation criteria or procedures established or accepted by MNR.
2. The MNR confirms that the site investigation and records review were conducted using applicable evaluation criteria or procedures established or accepted by MNR, if no natural features were identified.
3. The MNR confirms that the evaluation of the significance or provincial significance of the natural features was conducted using applicable evaluation criteria or procedures established or accepted by MNR.
4. The MNR confirms that the project location is not in a provincial park or conservation reserve.
5. The MNR confirms that the environmental impact study report has been prepared in accordance with procedures established by the MNR.

This confirmation letter is valid for the project as proposed in the natural heritage assessment and environmental impact study, including those sections describing the Environmental Effects Monitoring Plan and Construction Plan Report. Should any changes be made to the proposed project that would alter the NHA, MNR may need to undertake additional review of the NHA.

Where specific commitments have been made by the applicant in the NHA with respect to project design, construction, rehabilitation, operation, mitigation, or monitoring, MNR expects that these commitments will be considered in MOE's Renewable Energy Approval decision and, if approved, be implemented by the applicant.

In accordance with S.12 (1) of the Renewable Energy Approvals Regulation, this letter must be included as part of your application submitted to the MOE for a Renewable Energy Approval.

Please be aware that your project may be subject to additional legislative approvals as outlined in the Ministry of Natural Resources' *Approvals and Permitting Requirements Document*. These approvals are required prior to the construction of your renewable energy facility.

If you wish to discuss any part of this confirmation or additional comments provided, please contact Jennifer Telford at 705-272-7130.

Yours sincerely,



Martha Heidenheim
A/District Manager
Cochrane District - OMNR

cc. Christine Greenaway, A/Renewable Energy Coordinator, Northeast Region, MNR
Narren Santos, Environmental Assessment and Approvals Branch, MOE
Sandra Guido, Senior Program Support Coordinator, MOE

Appendix Q

**Letter of Confirmation –
Ontario Ministry of Tourism and Culture**

Ministry of Tourism and Culture

Culture Programs Unit
Programs and Services Branch
Culture Division
435 S. James St., Suite 334
Thunder Bay, ON P7E 6S7
Tel.: 807 475-1638
Fax: 807 475-1297

Ministère du Tourisme et de la Culture

Unité des programmes culturels
Direction des programmes et des services
Division de culture
Bureau 334, 435 rue James sud
Thunder Bay, ON P7E 6S7
Tél.: 807 475-1638
Télééc.: 807 475-1297



December 9, 2010

Tom Hockin
Northland Power
30 St. Clair Avenue West
17th Floor
Toronto, ON
M4V 3A1
Tom.Hockin@Northlandpower.ca

RE: Abitibi Solar Project

Location: Part Lots 14 & 15, Concession 8, Geographic Township of Glackmeyer, District of Cochrane

FIT #: FAQLBA0

MTC File #: HD00547

PIF: P007-279-2010

Dear Mr Hockin,

This letter constitutes the Ministry of Tourism and Culture's written comments as required by s. 22(3)(a) of O. Reg. 359/09 under the *Environmental Protection Act* regarding archaeological assessments undertaken for the above project.

Based on the information contained in the report you have submitted for this project, the Ministry believes the archaeological assessment complies with the *Ontario Heritage Act's* licensing requirements, including the licence terms and conditions and the Ministry's 1993 Archaeological Assessment Technical Guidelines. Please note that the Ministry makes no representation or warranty as to the completeness, accuracy or quality of the report.*

The report recommends the following:

- Over the course of the Stage 2 archaeological assessment, no materials with significant cultural heritage value or interest were recovered. Accordingly, **Archaeological Research Associates Ltd.** feels that no further archaeological study of the area would be productive. It is recommended that the project be released from further heritage concerns. A **Letter of Concurrence** with these recommendations is requested.
- This report is filed with the Minister of Tourism and Culture as a condition of licensing in accordance with Part VI of the Ontario Heritage Act, R.S.O. 1990, c. 0.18 The report will be reviewed to ensure that the licensed consultant archaeologist has met the terms and conditions of their archaeological licence, and that the archaeological fieldwork and report recommendations ensure the conservation, protection and preservation of the cultural heritage of Ontario.
- Should previously undocumented archaeological resources be discovered, they may be a new archaeological site and therefore subject to Section 48 (1) of the *Ontario Heritage Act*. The proponent or person discovering the archaeological resources must cease alteration of the site immediately and engage a licensed consultant archaeologist to carry out archaeological fieldwork, in compliance with Section 48 (1) of the *Ontario Heritage Act*. This condition provides for the potential for deeply buried or enigmatic local site areas not typically identified in evaluations of potential.
- The Cemeteries Act requires that any person discovering human remains must immediately notify the police or coroner and the Registrar of Cemeteries, Ministry of Small Business and Consumer Services. All work in the vicinity of the discovery will be suspended immediately. Other government staff may be contacted as appropriate; however, media contact should not be made in regard to the discovery.
- Archaeological sites recommended for further archaeological fieldwork or protection remain subject to Section 48 (1) of the *Ontario Heritage Act*, and may not be altered, or have artifacts removed, except by a person holding an archaeological licence.

The Ministry is satisfied with these recommendations.

This letter does not waive any requirements which you may have under the *Ontario Heritage Act*. A separate letter addressing archaeological licensing obligations under the Act will be sent to the archaeologist who completed the assessment and will be copied to you.

This letter does not constitute approval of the renewable energy project. Approvals of the project may be required under other statutes and regulations. It is your responsibility to obtain any necessary approvals or licences. Please feel free to contact me if you have questions or require additional information.

Sincerely,

Paige Campbell
Archaeology Review Officer
paige.campbell@ontario.ca

cc. Paul Racher, Archaeological Research Associates Ltd.
Kimberley Arnold, Hatch Ltd.
Shari Prowse, ARO/GEA Coordinator, Ministry of Tourism and Culture

*In no way will the Ministry be liable for any harm, damages, costs, expenses, losses, claims or actions that may result: (a) if the report or its recommendations are discovered to be inaccurate, incomplete, misleading or fraudulent; or (b) from the issuance of this letter. Further measures may need to be taken in the event that additional artifacts or archaeological sites are identified or the Report(s) is otherwise found to be inaccurate, incomplete, misleading or fraudulent.

Ministry of Tourism,
Culture and Sport

Ministère du Tourisme,
de la Culture et du Sport

Culture Programs Unit
Programs and Services Branch
Culture Division
435 S. James St., Suite 334
Thunder Bay, ON, P7E 6S7
Telephone: 807-475-1632
Facsimile: 807-475-1291

Unité des programmes culturels
Direction des programmes et des services
Division de culture
435 rue James sud, Bureau 334
Thunder Bay, ON, P7E 6S7
Téléphone: 807-475-1632
Télécopieur: 807-4751291



Email: andrew.hinshelwood@Ontario .ca

September 06, 2012

Northland Power Inc.
30 St. Clair Ave., West, 12th Floor
Toronto ON M4V 3A1

Attn.: Rob Miller

RE: Northland Power Empire Solar Project

Part of Lots 17 and 18, Concession 7, Township of Glackmeyer, District of Cochrane.

MTC File HD000546
MTC PIF P052-393-2012

Dear Proponent:

This letter constitutes the Ministry of Tourism and Culture's written comments as required by s. 22(3)(a) of O. Reg. 359/09 under the *Environmental Protection Act* regarding archaeological assessments undertaken for the above project.

Based on the information contained in the report(s) you have submitted for this project, the Ministry believes the archaeological assessment complies with the *Ontario Heritage Act's* licensing requirements, including the licence terms and conditions and the Ministry's 1993 Archaeological Assessment Technical Guidelines or the 2011 Standards and Guidelines for Consultant Archaeologists (whichever apply). Please note that the Ministry makes no representation or warranty as to the completeness, accuracy or quality of the report(s).*

The Archaeological Assessment Report Entitled, *Stage 1 and 2 Archaeological Assessment for Northland Power - Empire Solar Project, Part of Lots 17 and 18, Concession 7, Township of*

Glackmeyer, District of Cochrane, dated August 8, 2012, received by MTC Toronto Office on August 15, 2012, recommends the following:


- The Stage 2 survey did not identify any archaeological sites requiring further assessment or mitigation of impacts and it is recommended that no further archaeological assessment of the property be required.

This letter does not waive any requirements which you may have under the Ontario *Heritage Act*. A separate letter addressing archaeological licensing obligations under the Act will be sent to the archaeologist who completed the assessment and will be copied to you.

This letter does not constitute approval of the renewable energy project. Approvals of the project may be required under other statutes and regulations. It is your responsibility to obtain any necessary approvals or licences.

Please feel free to contact me if you have questions or require additional information.

Sincerely,

A handwritten signature in cursive script that reads "A Hinshelwood." The signature is written in black ink on a light blue rectangular background.

Andrew Hinshelwood
Archaeology Review Officer

cc. Rob.Miller@Northlandpower.ca

* In no way will the Ministry be liable for any harm, damages, costs, expenses, losses, claims or actions that may result: (a) if the Report(s) or its recommendations are discovered to be inaccurate, incomplete, misleading or fraudulent; or (b) from the issuance of this letter. Further measures may need to be taken in the event that additional artifacts or archaeological sites are identified or the Report(s) is otherwise found to be inaccurate, incomplete, misleading or fraudulent.

Ministry of Tourism and Culture

Culture Programs Unit
Programs and Services Branch
Culture Division
435 S. James St., Suite 334
Thunder Bay, ON P7E 6S7
Tel.: 807 475-1638
Fax: 807 475-1297

Ministère du Tourisme et de la Culture

Unité des programmes culturels
Direction des programmes et des services
Division de culture
Bureau 334, 435 rue James sud
Thunder Bay, ON P7E 6S7
Tél.: 807 475-1638
Télééc.: 807 475-1297



December 9, 2010

Tom Hockin
Northland Power
30 St. Clair Avenue West
17th Floor
Toronto, ON
M4V 3A1
Tom.Hockin@Northlandpower.ca

RE: Empire Solar Project

Location: Part Lots 17 & 18, Concession 8, Geographic Township of Glackmeyer, District of Cochrane

FIT #: FQJ0FUC

MTC File #: HD00546

PIF: P007-282-2010

Dear Mr Hockin,

This letter constitutes the Ministry of Tourism and Culture's written comments as required by s. 22(3)(a) of O. Reg. 359/09 under the *Environmental Protection Act* regarding archaeological assessments undertaken for the above project.

Based on the information contained in the report you have submitted for this project, the Ministry believes the archaeological assessment complies with the *Ontario Heritage Act's* licensing requirements, including the licence terms and conditions and the Ministry's 1993 Archaeological Assessment Technical Guidelines. Please note that the Ministry makes no representation or warranty as to the completeness, accuracy or quality of the report.*

The report recommends the following:

- Over the course of the Stage 2 archaeological assessment, no materials with significant cultural heritage value or interest were recovered. Accordingly, **Archaeological Research Associates Ltd.** feels that no further archaeological study of the area would be productive. It is recommended that the project be released from further heritage concerns. A **Letter of Concurrence** with these recommendations is requested.
- This report is filed with the Minister of Tourism and Culture as a condition of licensing in accordance with Part VI of the Ontario Heritage Act, R.S.O. 1990, c. 0.18 The report will be reviewed to ensure that the licensed consultant archaeologist has met the terms and conditions of their archaeological licence, and that the archaeological fieldwork and report recommendations ensure the conservation, protection and preservation of the cultural heritage of Ontario.
- Should previously undocumented archaeological resources be discovered, they may be a new archaeological site and therefore subject to Section 48 (1) of the *Ontario Heritage Act*. The proponent or person discovering the archaeological resources must cease alteration of the site immediately and engage a licensed consultant archaeologist to carry out archaeological fieldwork, in compliance with Section 48 (1) of the *Ontario Heritage Act*. This condition provides for the potential for deeply buried or enigmatic local site areas not typically identified in evaluations of potential.
- The Cemeteries Act requires that any person discovering human remains must immediately notify the police or coroner and the Registrar of Cemeteries, Ministry of Small Business and Consumer Services. All work in the vicinity of the discovery will be suspended immediately. Other government staff may be contacted as appropriate; however, media contact should not be made in regard to the discovery.
- Archaeological sites recommended for further archaeological fieldwork or protection remain subject to Section 48 (1) of the *Ontario Heritage Act*, and may not be altered, or have artifacts removed, except by a person holding an archaeological licence.

The Ministry is satisfied with these recommendations.

This letter does not waive any requirements which you may have under the *Ontario Heritage Act*. A separate letter addressing archaeological licensing obligations under the Act will be sent to the archaeologist who completed the assessment and will be copied to you.

This letter does not constitute approval of the renewable energy project. Approvals of the project may be required under other statutes and regulations. It is your responsibility to obtain any necessary approvals or licences. Please feel free to contact me if you have questions or require additional information.

Sincerely,

Paige Campbell
Archaeology Review Officer
paige.campbell@ontario.ca

cc. Paul Racher, Archaeological Research Associates Ltd.
Kimberley Arnold, Hatch Ltd.
Shari Prowse, ARO/GEA Coordinator, Ministry of Tourism and Culture

*In no way will the Ministry be liable for any harm, damages, costs, expenses, losses, claims or actions that may result: (a) if the report or its recommendations are discovered to be inaccurate, incomplete, misleading or fraudulent; or (b) from the issuance of this letter. Further measures may need to be taken in the event that additional artifacts or archaeological sites are identified or the Report(s) is otherwise found to be inaccurate, incomplete, misleading or fraudulent.

Ministry of Tourism and Culture

Culture Programs Unit
Programs and Services Branch
Culture Division
435 S. James St., Suite 334
Thunder Bay, ON P7E 6S7
Tel.: 807 475-1638
Fax: 807 475-1297

Ministère du Tourisme et de la Culture

Unité des programmes culturels
Direction des programmes et des services
Division de culture
Bureau 334, 435 rue James sud
Thunder Bay, ON P7E 6S7
Tél.: 807 475-1638
Télééc.: 807 475-1297



December 9, 2010

Tom Hockin
Northland Power
30 St. Clair Avenue West
17th Floor
Toronto, ON
M4V 3A1
Tom.Hockin@Northlandpower.ca

RE: Martin's Meadows Solar Project

Location: Lot 16, Concession 8, Geographic Township of Glackmeyer, District of Cochrane

FIT #: FM5F42U

MTC File #: HD00548

PIF: P007-281-2010

Dear Mr Hockin,

This letter constitutes the Ministry of Tourism and Culture's written comments as required by s. 22(3)(a) of O. Reg. 359/09 under the *Environmental Protection Act* regarding archaeological assessments undertaken for the above project.

Based on the information contained in the report you have submitted for this project, the Ministry believes the archaeological assessment complies with the *Ontario Heritage Act's* licensing requirements, including the licence terms and conditions and the Ministry's 1993 Archaeological Assessment Technical Guidelines. Please note that the Ministry makes no representation or warranty as to the completeness, accuracy or quality of the report.*

The report recommends the following:

- Over the course of the Stage 2 archaeological assessment, no materials with significant cultural heritage value or interest were recovered. Accordingly, **Archaeological Research Associates Ltd.** feels that no further archaeological study of the area would be productive. It is recommended that the project be released from further heritage concerns. A **Letter of Concurrence** with these recommendations is requested.
- This report is filed with the Minister of Tourism and Culture as a condition of licensing in accordance with Part VI of the Ontario Heritage Act, R.S.O. 1990, c. 0.18 The report will be reviewed to ensure that the licensed consultant archaeologist has met the terms and conditions of their archaeological licence, and that the archaeological fieldwork and report recommendations ensure the conservation, protection and preservation of the cultural heritage of Ontario.
- Should previously undocumented archaeological resources be discovered, they may be a new archaeological site and therefore subject to Section 48 (1) of the *Ontario Heritage Act*. The proponent or person discovering the archaeological resources must cease alteration of the site immediately and engage a licensed consultant archaeologist to carry out archaeological fieldwork, in compliance with Section 48 (1) of the *Ontario Heritage Act*. This condition provides for the potential for deeply buried or enigmatic local site areas not typically identified in evaluations of potential.
- The Cemeteries Act requires that any person discovering human remains must immediately notify the police or coroner and the Registrar of Cemeteries, Ministry of Small Business and Consumer Services. All work in the vicinity of the discovery will be suspended immediately. Other government staff may be contacted as appropriate; however, media contact should not be made in regard to the discovery.
- Archaeological sites recommended for further archaeological fieldwork or protection remain subject to Section 48 (1) of the *Ontario Heritage Act*, and may not be altered, or have artifacts removed, except by a person holding an archaeological licence.

The Ministry is satisfied with these recommendations.

This letter does not waive any requirements which you may have under the *Ontario Heritage Act*. A separate letter addressing archaeological licensing obligations under the Act will be sent to the archaeologist who completed the assessment and will be copied to you.

This letter does not constitute approval of the renewable energy project. Approvals of the project may be required under other statutes and regulations. It is your responsibility to obtain any necessary approvals or licences. Please feel free to contact me if you have questions or require additional information.

Sincerely,

Paige Campbell
Archaeology Review Officer
paige.campbell@ontario.ca

cc. Paul Racher, Archaeological Research Associates Ltd.
Kimberley Arnold, Hatch Ltd.
Shari Prowse, ARO/GEA Coordinator, Ministry of Tourism and Culture

*In no way will the Ministry be liable for any harm, damages, costs, expenses, losses, claims or actions that may result: (a) if the report or its recommendations are discovered to be inaccurate, incomplete, misleading or fraudulent; or (b) from the issuance of this letter. Further measures may need to be taken in the event that additional artifacts or archaeological sites are identified or the Report(s) is otherwise found to be inaccurate, incomplete, misleading or fraudulent.

Ministry of Tourism, Culture and Sport

Culture Programs Unit
Programs and Services Branch
Culture Division
435 S. James Street, Suite 334
Thunder Bay ON P7E 6S7
Tel.: 807-475-1628
Email: paige.campbell@ontario.ca

Ministère du Tourisme, de la Culture et du Sport

Unité des programmes culturels
Direction des programmes et des services
Division de culture
435, rue James sud, bureau 334
Thunder Bay ON P7E 6S7
Tél.: 807-475-1628
Email: paige.campbell@ontario.ca



February 15, 2013

T. Keith Powers
The Archaeologists Inc.
790 Exceller Circle
Newmarket, ON L3X 1P6

Dear Mr. Powers,

RE: Review and Entry into the Ontario Public Register of Archaeological Reports: Archaeological Assessment Report Entitled, *Stage 1 and 2 Archaeological Assessment for Northland Power – Additional Lands (Martin’s Meadows & Abitibi Solar Projects) Part of Lot 15, Concession 8, Township of Glackmeyer, District of Cochrane FIT Contract # - F-000688-SPV-130-505 & F-000691-SPV-130-505 (FIT-FM5F42U & FIT-FAQLBA0)*, Dated January 23, 2013, Filed by MTCS Toronto Office January 28, 2013, MTCS Project Information Form Number P052-409-2012, MTCS File Number HD00547

This office has reviewed the above-mentioned report, which has been submitted to this ministry as a condition of licensing in accordance with Part VI of the *Ontario Heritage Act*, R.S.O. 1990, c 0.18.¹ This review has been carried out in order to determine whether the licensed professional consultant archaeologist has met the terms and conditions of their licence, that the licensee assessed the property and documented archaeological resources using a process that accords with the 2011 *Standards and Guidelines for Consultant Archaeologists* set by the ministry, and that the archaeological fieldwork and report recommendations are consistent with the conservation, protection and preservation of the cultural heritage of Ontario.²

¹ *This letter constitutes the Ministry of Tourism, Culture and Sport’s written comments where required pursuant to section 22 of O. Reg. 359/09, as amended (Renewable Energy Approvals under the Environmental Protection Act), regarding the archaeological assessment undertaken for the above-captioned project. Depending on the study area and scope of work of the archaeological assessment as detailed in the report, further archaeological assessment reports may be required to complete the archaeological assessment for the project under O. Reg. 359/09. In that event Ministry comments pursuant to section 22 of O. Reg. 359/09 will be required for any such additional reports.*

² *In no way will the ministry be liable for any harm, damages, costs, expenses, losses, claims or actions that may result: (a) if the Report(s) or its recommendations are discovered to be inaccurate, incomplete, misleading or fraudulent; or (b) from the issuance of this letter. Further measures may need to be taken in the event that additional artifacts or archaeological sites are identified or the Report(s) is otherwise found to be inaccurate, incomplete, misleading or fraudulent.*

The report documents the assessment of the study area as depicted in Map 2 of the above titled report and recommends the following:

The Stage 2 survey did not identify any archaeological sites requiring further assessment or mitigation of impacts and it is recommended that no further archaeological assessment of the property be required.

Based on the information contained in the report, the ministry is satisfied that the fieldwork and reporting for the archaeological assessment are consistent with the ministry's 2011 *Standards and Guidelines for Consultant Archaeologists* and the terms and conditions for archaeological licences. This report has been entered into the Ontario Public Register of Archaeological Reports. Please note that the ministry makes no representation or warranty as to the completeness, accuracy or quality of reports in the register.

Should you require any further information regarding this matter, please feel free to contact me.

Sincerely,

Paige Campbell
Archaeology Review Officer

cc. Mr. Rob Miller, Northland Power Inc.

Ministry of Tourism,
Culture and Sport

Ministère du Tourisme,
de la Culture et du Sport

Culture Programs Unit
Programs and Services Branch
Culture Division
435 S. James St., Suite 334
Thunder Bay, ON, P7E 6S7
Telephone: 807-475-1632
Facsimile: 807-475-1291

Unité des programmes culturels
Direction des programmes et des services
Division de culture
435 rue James sud, Bureau 334
Thunder Bay, ON, P7E 6S7
Téléphone: 807-475-1632
Télécopieur: 807-4751291



Email: andrew.hinshelwood@Ontario.ca

June 15, 2012

Hatch Ltd.
4342 Queen St., Suite 500
Niagara Falls, ON L2E 7J7

Northland Power
30 St. Clair Ave. W., 17th Floor
Toronto, ON M4V 3A1

Attn.: Kimberley Arnold
larnold@hatch.ca

Tom Hockin
tom.hockin@northlandpower.ca

RE: 115kV Transmission Line

**Geo. Twp. Glackmeyer, Clute and Calder,
District of Cochrane**

MTC File HD000675

MTC PIF P007-378-2011

Dear Proponent:

This letter constitutes the Ministry of Tourism and Culture's written comments as required by s. 22(3)(a) of O. Reg. 359/09 under the *Environmental Protection Act* regarding archaeological assessments undertaken for the above project.

Based on the information contained in the report(s) you have submitted for this project, the Ministry believes the archaeological assessment complies with the *Ontario Heritage Act's* licensing requirements, including the licence terms and conditions and the Ministry's 1993 Archaeological Assessment Technical Guidelines or the 2011 Standards and Guidelines for Consultant Archaeologists (whichever apply). Please note that the Ministry makes no representation or warranty as to the completeness, accuracy or quality of the report(s).*

The Archaeological Assessment Report Entitled, *Stage 1 and 2 Archaeological Assessments 115 kV Transmission Line Geo. Townships of Glackmeyer, Clute and Calder District of Cochrane, Ontario*, dated December 12, 2011, received MTCS Toronto office, December 08, 2011, recommends the following:

- *The Stage 1 and 2 archaeological assessment of the project lands were completed in November, 2011. The Stage 1 background study demonstrated that the study area*

consisted of areas of archaeological potential and areas of no archaeological potential. The Stage 2 property assessment of the project lands, conducted under optimal conditions, did not result in the identification of any archaeological materials.

- *Based on these findings, ARA feels that no further archaeological assessment of the study area would be productive. It is recommended that the project lands be released from further archaeological concerns.*


The Ministry is satisfied with these recommendations.

This letter does not waive any requirements which you may have under the Ontario *Heritage Act*. A separate letter addressing archaeological licensing obligations under the Act will be sent to the archaeologist who completed the assessment and will be copied to you.

This letter does not constitute approval of the renewable energy project. Approvals of the project may be required under other statutes and regulations. It is your responsibility to obtain any necessary approvals or licences.

Please feel free to contact me if you have questions or require additional information.

Sincerely,

A handwritten signature in cursive script that reads "A Hinshelwood." The signature is written in black ink on a light blue rectangular background.

Andrew Hinshelwood
Archaeology Review Officer

cc. Paul Racher, ARA, pracher@arch-research.com
Mansoor Mahmood, MOE, mansoor.mahmood@ontario.ca

* In no way will the Ministry be liable for any harm, damages, costs, expenses, losses, claims or actions that may result: (a) if the Report(s) or its recommendations are discovered to be inaccurate, incomplete, misleading or fraudulent; or (b) from the issuance of this letter. Further measures may need to be taken in the event that additional artifacts or archaeological sites are identified or the Report(s) is otherwise found to be inaccurate, incomplete, misleading or fraudulent.